DATE No. REVISION

APPROVED BY: DRAWING NO.:

COVER SHEET

G0.01


SHEET

CHABOT-LAS POSITAS COMMUNITY COLLEGE DISTRICT

LAS POSITAS COLLEGE

3000 CAMPUS HILL DRIVE LIVERMORE, CA 94551

DOMESTIC WATER BOOSTER PUMP PROJECT 100% CONSTRUCTION DOCUMENTS DECEMBER 07, 2020

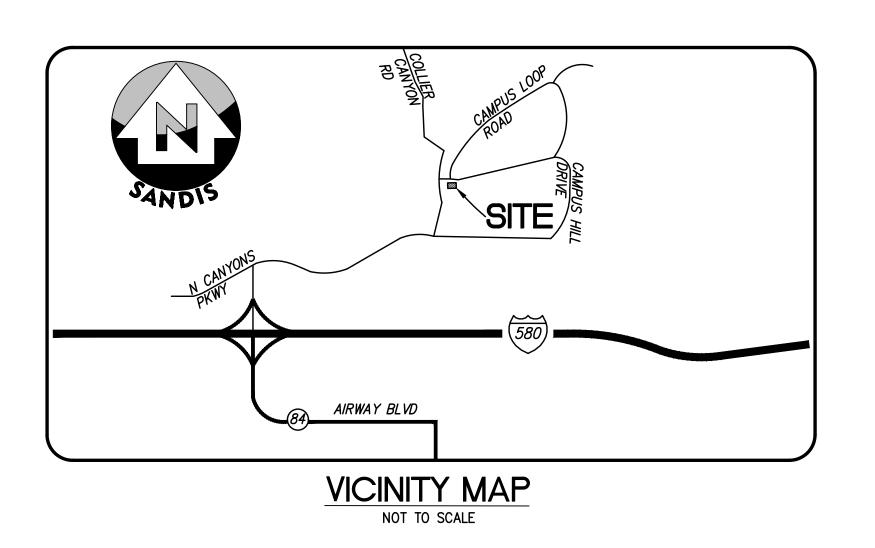

PROJECT DIRECTORY

OWNER INFO

CHABOT-LOS POSITAS CCD CONTACT PERSON: OWEN LETCHER 7600 DUBLIN BLVD DUBLIN, CA 94568 PH: 925.485.5277 EMAIL: OLETCHER@CLPCCD.ORG

LOS POSITAS COLLEGE CONTACT PERSON: ANN KROLL PH: 510.514.1369 EMAIL: AKROLL@CLPCCD.ORG

CIVIL ENGINEER

CONTACT PERSON: BRIAN CANCIMILLA 636 9TH STREET OAKLAND, CA 94607 PH: 510.873.8866

ELECTRICAL ENGINEER

CONTACT PERSON: ANGELICA CHOW 220 MONTGOMERY ST #650 SAN FRANCISCO, CA 94104 PH: 415.364.7211

PLUMBING ENGINEER

CONTACT PERSON: MIKE MARSHALL 220 MONTGOMERY ST #650 SAN FRANCISCO, CA 94104 PH: 415.364.7247

PROJECT DESCRIPTION

BOOSTER PUMP SYSTEM TO RAISE THE CAMPUS DOMESTIC WATER PRESSURE. PRESSURE REDUCING VALVES WILL BE INSTALLED AT SELECTED BUILDINGS TO PREVENT OVERPRESSURE OF PLUMBING FIXTURES.

COVER SHEET CO.01 CIVIL NOTES, LEGEND, AND ABBREVIATIONS CO.10 TOPOGRAPHIC SURVEY (FOR REFERENCE ONLY) C1.01 SITE PLAN C1.02 SITE PLAN C2.01 UTILITY PLAN C2.02 UTILITY PLAN C2.03 UTILITY PLAN C3.01 CIVIL CONSTRUCTION DETAILS <u>PLUMBING</u> PO.00 PLUMBING COVER SHEET P1.00 PLUMBING OVERALL SITE PLAN

P1.01 PLUMBING ENLARGED SITE PLAN AND DETAILS <u>ELECTRICAL</u>

E0.00 ELECTRICAL COVER SHEET E1.00 ELECTRICAL OVERALL SITE PLAN ELECTRICAL ENLARGED SITE PLAN AND PARTIAL SINGLE LINE

	<u>EXISTING</u>	<u>PROPOSED</u>
SAWCUT AND CONFORM LINE		
RETAINING WALL		
A.C. PAVEMENT		
CONC. VALLEY GUTTER		
CONC. SIDEWALK OR PAD		
6" CURB & GUTTER		
EDGE OF A.C. PAVEMENT	EP-	
6" VERTICAL CURB		
CENTER LINE		
SANITARY SEWER MAIN	8"SS	SS
STORM DRAIN MAIN	<u>12"</u> SD	SD
PERFORATED PIPE	. "	—b
WATER MAIN	6"W	——————————————————————————————————————
FIRE WATER MAIN	6" FW —	——————————————————————————————————————
DOMESTIC WATER MAIN	6" OUW	——————————————————————————————————————
CHILLED WATER MAIN	——CHW——	——————————————————————————————————————
RRIGATION LINE	IRR	4"IRR
HOT WATER SUPPLY & RETURN	HWS-HWR	————НWS——— ————НWR————
STEAM LINE	ST	ST
TRENCH DRAIN		
CONDENSATE RETURN	——————————————————————————————————————	
METAL BEAM GUARD RAIL		—————
SILT FENCE		 •
FLOW LINE		
CHAIN LINK FENCE	xx	××
GAS MAIN	G	
TLECTRIC AND SIGNAL DUCT BANK	——— E———	———E——
OVERHEAD ELECTRIC LINE	OHE	OHE
INDERGROUND ELECTRIC LINE	UGE	——————————————————————————————————————
STREET LIGHT CONDUIT	SL	SL
CONTOUR ELEVATION LINE	 85 	90
SPOT ELEVATION	x 95.94 %	FG 95.94
DIRECTION OF SLOPE	x 95.94 8%	<u>2</u> :1 _1%
GAS METER	G	G M
GAS VALVE	GV	GV
WATER METER		■ WM
WATER VALVE	WV V	wv •
FIRE HYDRANT	X +0+	※
BACK FLOW PREVENTOR	₩ 101	****
POST INDICATOR VALVE	PIV	PIV
FIRE DEPARTMENT CONNECTION	Q.	♣
WATER LINE TEE	^ <u>n</u> o	, <u>†</u> ,
CAP AND PLUG END		
AIR RELEASE VALVE		■ ARV
SIGN	4	•
ACCESSIBLE RAMP		
CONCRETE THRUST BLOCK	71 1	
REDUCER		\blacksquare
SANITARY SEWER MANHOLE	\circ	•
SANITARY SEWER CLEANOUT	SSCO	SSCO
STORM DRAIN MANHOLE		
STORMCEPTOR		
STORM DRAIN AREA DRAIN		
STORM DRAIN CATCH BASIN	□CB	
STORM DRAIN CURB INLET		
STORM DRAIN CLEANOUT	SDCO	SDCO
ELECTROLIER	G *	° * * • ∶
JOINT POLE	JP -0-	-0-
OVERLAND RELEASE		\rightarrow

ABBREVIATIONS

AGGREGATE BASE ASPHALT CONCRETE AREA DRAIN AMERICANS WITH DISABILITIES ACT AGGREGATE SUBBASE BEGINNING OF CURVE BACK FLOW PREVENTOR BUILDING CORNER BUILDING BOTTOM OF DOCK *BOLLARD* BOTTOM OF STEP FG @ BOTTOM OF WALL BEGIN VERTICAL CURVE BACK OF WALK CONCRETE OR CIVIL CURB AND GUTTER CATCH BASIN CURB INLET CAST IRON PIPE CENTER LINE OR CLASS CORRUGATED METAL PIPE CONCRETE CONST CONSTRUCTION OR CONSTRUCT *CUBIC YARD* DOUBLE CHECK DETECTOR ASSEMBLY DUCTILE IRON PIPE DOMESTIC

DOMESTIC WATER DRAWING END OF CURVE EDGE OF PAVEMENT END OF RETURN END VERTICAL CURVE ELE VA TION FACE OF CURB FIRE DEPARTMENT CONNECTION

FINISHED FLOOR FINISHED GRADE FIRE HYDRANT FLOW LINE FOUNDATION FINISHED SURFACE GROUND ELEVATION – *GRADE BREAK* GATE VALVE ACCESSIBLE RAMP HIGH POINT

 INVERT ELEVATION JOINT POLE JOINT TRENCH LIP OF GUTTER LOW POINT LANDSCAPE ARCHITECT MAXIMUM MECHANICAL/ELECTRICAL/PLUMBING MANHOLE MINIMUM MIDPOINT OF VERTICAL CURVE MONUMENT NOT IN CONTRACT

NUMBER NOT TO SCALE PAVEMENT ELEVATION PORTLAND CEMENT CONCRETE / POINT OF CONTINUOUS CURVATURE POST INDICATOR VALVE PROPERTY LINE POWER MANHOLE POINT ON CURVE POWFR POLF POINT OF REVERSE CURVATURE POLYVINYL CHLORIDE PIPE RADIUS - RELATIVE COMPACTION

REINFORCED CONCRETE PIPE REDUCED PRESSURE PRINCIPLE ASSEMBLY RIGHT OF WAY SLOPE OR SOUTH SEE ARCHITECTURAL DRAWINGS SEDIMENT BASIN STORM DRAIN SEE ELECTRICAL DRAWINGS SILT FENCE SUBGRADE SEE LANDSCAPE DRAWINGS SEE MECHANICAL DRAWINGS SIGNAL MANHOLE SEE PLUMBING DRAWINGS SANITARY SEWER STANDARD SIDEWALK TRENCH DRAIN

R/W

S.M.D.

· TOP OF DOCK - TOE OF SLOPE - TOP OF STAIR - FG @ TOP OF WALL TOP OF SLAB UNLESS OTHERWISE NOTED UNDERGROUND VERTICAL CURVE WATER METER WATER VALVE WELDED WIRE FABRIC – WITH

CONSTRUCTION NOTES

- 1. ALL OFF-SITE CONSTRUCTION MATERIAL AND METHODS SHALL COMPLY WITH THE WITH THE LATEST EDITION OF THE CITY OF LIVERMORE STANDARD PLANS & SPECIFICATIONS AND THE LATEST CALTRANS STANDARD SPECIFICATIONS.
- 2. CONTRACTOR SHALL POST ON THE SITE, EMERGENCY TELEPHONE NUMBERS FOR AMBULANCE, POLICE, AND FIRE DEPARTMENTS.
- 3. CONTRACTOR SHALL NOTIFY ALL PUBLIC OR PRIVATE UTILITY OWNERS 48 HOURS PRIOR TO COMMENCEMENT OF WORK ADJACENT TO THE UTILITY UNLESS AN EXCAVATION PERMIT SPECIFIES OTHERWISE.
- 4. UTILITIES AND UNDERGROUND FACILITIES INDICATED ARE FOR INFORMATION ONLY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE LOCATION AND DEPTH WITH THE APPROPRIATE AGENCIES. NEITHER THE OWNER NOR THE CITY NOR THE DESIGN PROFESSIONAL ASSUMES RESPONSIBILITY THAT THE UTILITIES AND UNDERGROUND FACILITIES INDICATED WILL BE THE UTILITIES AND UNDERGROUND FACILITIES ENCOUNTERED.
- 5. CONTRACTOR TO CONTACT OWNERS REPRESENTATIVE FORTY—EIGHT (48) HOURS PRIOR TO BEGINNING WORK. CONTRACTOR TO HAVE THE LOCATION OF EXISTING UNDERGROUND UTILITIES MARKED. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO IDENTIFY, LOCATE, AND PROTECT ALL UNDERGROUND FACILITIES.
- 6. THE CONTRACTOR SHALL HIRE A STREET CLEANING CONTRACTOR TO CLEAN UP DIRT AND DEBRIS FROM CITY STREETS AND CAMPUS STREETS AND PARKING LOT THAT ARE ATTRIBUTABLE TO THE DEVELOPMENT'S CONSTRUCTION ACTIVITIES.
- 7. ALL GRADING SHALL BE PERFORMED IN SUCH A MANNER AS TO COMPLY WITH THE STANDARDS ESTABLISHED BY THE AIR QUALITY MAINTENANCE DISTRICT FOR AIRBORNE PARTICULATES (DUST). 8. ALL GRADING SHALL CONFORM TO APPROVED SPECIFICATIONS PRESENTED
- HEREON OR ATTACHED HERETO. ALL GRADING WORK SHALL BE OBSERVED AND APPROVED BY THE SOILS ENGINEER. THE SOILS ENGINEER SHALL BE NOTIFIED AT LEAST 48 HOURS BEFORE BEGINNING ANY GRADING. UNOBSERVED AND UNAPPROVED GRADING WORK SHALL BE REMOVED AND REDONE AT THE CONTRACTORS EXPENSE.
- 9. ALL MATERIALS, REQUIRED FOR THE COMPLETE EXECUTION OF THE PROJECT, SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR UNLESS OTHERWISE NOTED.
- 10. THE CONTRACTOR SHALL PROVIDE ALL LIGHTS, SIGNS, BARRICADES, FLAGMEN OR OTHER DEVICES NECESSARY TO PROVIDE FOR PUBLIC SAFETY DURING THE CONSTRUCTION PERIOD.
- 11. THE CONTRACTOR SHALL BE RESPONSIBLE TO REPAIR OR REPLACE ANY EXISTING IMPROVEMENTS OF UNDERGROUND FACILITIES DAMAGED DURING THE CONSTRUCTION PERIOD.
- 12. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL ENCROACHMENT, EXCAVATION, CONCRETE, ELECTRICAL, PLUMBING, ETC. PERMITS NECESSARY PRIOR TO BEGINNING CONSTRUCTION FOR ANY WORK.
- 13. THE CONTRACTOR SHALL HAVE A SUPERINTENDENT OR REPRESENTATIVE ON SITE AT ALL TIMES DURING CONSTRUCTION.
- 14. STORAGE OF CONSTRUCTION MATERIAL AND EQUIPMENT ON CITY STREETS AND CAMPUS ROADWAYS WILL NOT BE PERMITTED.
- 15. CONSTRUCTION EQUIPMENT SHALL BE PROPERLY MUFFLED. UNNECESSARY IDLING OF GRADING CONSTRUCTION EQUIPMENT IS PROHIBITED.
- 16. CONSTRUCTION EQUIPMENT, TOOLS, ETC. SHALL NOT BE CLEANED OR RINSED INTO A STREET, GUTTER OR STORM DRAIN.
- 17. A CONTAINED AND COVERED AREA ON-SITE SHALL BE USED FOR STORAGE OF CEMENT BAGS, PAINTS, FLAMMABLE, OILS, FERTILIZERS, PESTICIDES, OR ANY OTHER MATERIALS THAT HAVE POTENTIAL FOR BEING DISCHARGED TO THE
- STORM DRAIN SYSTEM BY WIND OR IN THE EVENT OF A MATERIAL SPILL. 18. ALL CONSTRUCTION DEBRIS SHALL BE GATHERED ON A REGULAR BASIS AND PLACED IN A DUMPSTER WHICH IS EMPTIED OR REMOVED WEEKLY. WHEN FEASIBLE, TARPS SHALL BE USED ON THE GROUND TO COLLECT FALLEN DEBRIS
- OR SPLATTERS THAT COULD CONTRIBUTE TO STORMWATER POLLUTION. 19. ANY TEMPORARY ON-SITE CONSTRUCTION PILES SHALL BE SECURELY COVERED WITH A TARP OR OTHER DEVICE TO CONTAIN DEBRIS.
- 20. CONCRETE TRUCKS AND CONCRETE FINISHING OPERATIONS SHALL NOT DISCHARGE WASH WATER INTO THE STREET GUTTERS OR DRAINS.
- 21. UNLESS OTHERWISE NOTED, ALL CONCRETE SHALL BE CALTRANS CLASS 2 WITH A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI. CONCRETE FOR PROPOSED THRUST BLOCKS SHALL ACHIEVE MINIMUM STRENGTH AS RAPIDLY AS POSSIBLE TO MINIMIZE DISRUPTION TO CAMPUS OPERATIONS.
- 22. THE CONTRACTOR SHALL PROVIDE THE DISTRICT WITH A DETAILED SCHEDULE FOR ANY SERVICES INTERRUPTION AND SHALL NOTIFY THE OWNERS REPRESENTATIVE AT LEAST 48 HOURS PRIOR TO COMMENCING A SHUTDOWN. THE SHUTDOWN PERIOD SHALL NOT EXCEED 24HOURS.

EARTHWORK NOTE

IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INCLUDE ALL MATERIAL AND LABOR REQUIRED WITHIN THE BID PRICE, FOR EARTHWORK CONSTRUCTION, TO CARRY OUT THE CUT/FILL AND/OR IMPORT/EXPORT AS NECESSARY TO MEET THE DESIGN GRADES SHOWN ON THE PLANS. CONTRACTOR IS TO DELIVER TO OWNER THE PROJECT IN A COMPLETE AND OPERATIONAL MANNER. EARTHWORK QUANTITIES SHOWN ON THE PLANS OR REPRESENTED BY THE ENGINEER ARE APPROXIMATE AND ARE FOR GRADING PERMIT APPROVAL ONLY. THE CONTRACTOR IS RESPONSIBLE FOR ANY INVESTIGATION OR STUDIES THAT ARE REQUIRED BY THE CONTRACTOR TO SATISFY THIS REQUIREMENT. NO ADDITIONAL COMPENSATION SHALL BE PAID FOR SAID CUT/FILL AND/OR IMPORT/EXPORT.

DISCREPANCIES

IF THERE ARE ANY DISCREPANCIES BETWEEN DIMENSIONS IN DRAWINGS AND EXISTING CONDITIONS WHICH WILL AFFECT THE WORK, THE CONTRACTOR SHALL BRING SUCH DISCREPANCIES TO THE ATTENTION OF THE ENGINEER FOR ADJUSTMENT BEFORE PROCEEDING WITH THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER FITTING OF ALL WORK AND FOR THE COORDINATION OF ALL TRADES,

UTILITY/POTHOLE NOTE

SUBCONTRACTORS, AND PERSONS ENGAGED UPON THIS CONTRACT.

THE TYPES, LOCATIONS, SIZES AND /OR DEPTHS OF EXISTING UNDERGROUND UTILITIES AS SHOWN ARE APPROXIMATE AND WERE OBTAINED FROM SOURCES OF VARYING RELIABILITY. ONLY ACTUAL EXCAVATION WILL REVEAL THE TYPES, EXTENT, SIZES, LOCATIONS AND DEPTHS OF SUCH UNDERGROUND UTILITIES. A REASONABLE EFFORT HAS BEEN MADE TO LOCATE AND DELINEATE ALL KNOWN UNDERGROUND UTILITIES. HOWEVER, THE ENGINEER CAN ASSUME NO RESPONSIBILITY FOR THE COMPLETENESS OR ACCURACY OF ITS DELINEATION OF SUCH UNDERGROUND UTILITIES WHICH MAY BE ENCOUNTERED, BUT WHICH ARE NOT SHOWN ON THESE PLANS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING ALL UNDERGROUND FACILITIES AND UTILITIES BY POTHOLING PRIOR TO COMMENCING CONSTRUCTION.

SURVEY NOTES

- 1. ALL DISTANCES AND DIMENSIONS ARE SHOWN IN FEET AND DECIMALS THEREOF. 2. DATE OF FIELD SURVEY: 08/26/20
- 3. COORDINATES, BEARINGS, AND DISTANCES SHOWN ARE BASED ON AN ASSUMED COORDINATE SYSTEM. SEE SURVEY CONTROL TABLE BELOW FOR PROJECT COORDINATES. THE VERTICAL DATUM FOR THE SURVEY IS BASED ON LAS POSITAS COLLEGE BENCHMARK NO. 22 - 3/4" IRON PIPE WITH PLUG ON THE SOUTH SIDE OF THE LOOP ROAD, APPROX. 1100' FROM THE WEST ENTRY TO THE CAMPUS FROM COLLIER CANYON ROAD. ELEVATION = 466.71

Point #	Elevation	Northing	Easting	Description
1	544.08	13183.80	13290.31	CUT X
3	540.66	13065.26	12784.71	CNTL
35	530.04	12503.70	12911.45	CUT X
37	537.93	12217.93	13008.92	60D FEATHER
38	515.89	11929.30	12605.77	CUT X

CATHODIC PROTECTION NOTE

THE EXISTING SOILS ON-SITE ARE KNOWN TO BE BE CORROSIVE TO BURIED METALLIC ELEMENTS. AN ANALYSIS OF AN EXISTING SOIL SAMPLE PROVIDES THE FOLLOWING CORROSION DATA:

SOIL CHARACTERISTICS	TEST RESULTS/CONDITION
CHLORIDE	190 PPM
PH	7.7
RESISTIVITY	800 OHM-CM
SULFIDE	140 PPM
MOISTURE	FAIR DRAINAGE

THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO INCLUDE ALL COMPONENTS OF THE CATHODIC PROTECTION SYSTEM, INCLUDING TEST STATION LOCATIONS, NUMBER, SIZE, AND TYPE OF ANODES, DIELECTRIC ISOLATING JOINTS, CABLES, COATING REPAIR, JOINT BONDS AND ANY OTHER WORK NECESSARY TO COMPLETE THE INSTALLATION FOR ALL UNDERGROUND METALLIC PIPE, FITTINGS, VALVES, AND APPURTENANCES. THE ANODES SHALL BE DESIGNED FOR A MINIMUM 20-YR DESIGN LIFE. LOCATE TEST STATIONS IN LANDSCAPE AREAS.



CONSTRUCTION CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, CONSTRUCTION CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY; THAT THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS AND CONSTRUCTION CONTRACTOR FURTHER AGREES TO DEFEND, INDEMNIFY AND HOLD DESIGN PROFESSIONAL HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING LIABILITY ARISING FROM SOLE NEGLIGENCE OF DESIGN PROFESSIONAL.

UNAUTHORIZED CHANGES AND USES **CAUTION:** THE ENGINEER PREPARING THESE PLANS WILL NOT BE RESPONSIBLE FOR, OR LIABLE FOR, UNAUTHORIZED CHANGES TO OR USES OF THESE PLANS. ALL CHANGES TO THE PLANS MUST BE IN WRITING AND MUST BE APPROVED BY THE PREPARER OF THE PLANS.

CIVIL ENGINEERS SURVEYORS PLANNERS

Oakland, CA 9460 P. 510.873.8866 F.510.873.8868 SILICON VALLEY TRI-VALLEY CENTRAL VALLEY EAST BAY/SF

DATE _ 12 / 07 MICHAEL A. KUYKENDALL R.C.F. NO. 70870. FXPIRFS 6-30-

DATE BY


SCALF: DRAWN BY: APPROVED BY: DRAWING NO.:


No. REVISION


CIVIL NOTES, LEGEND, AND **ABBREVIATIONS**


C0.01


SHEET

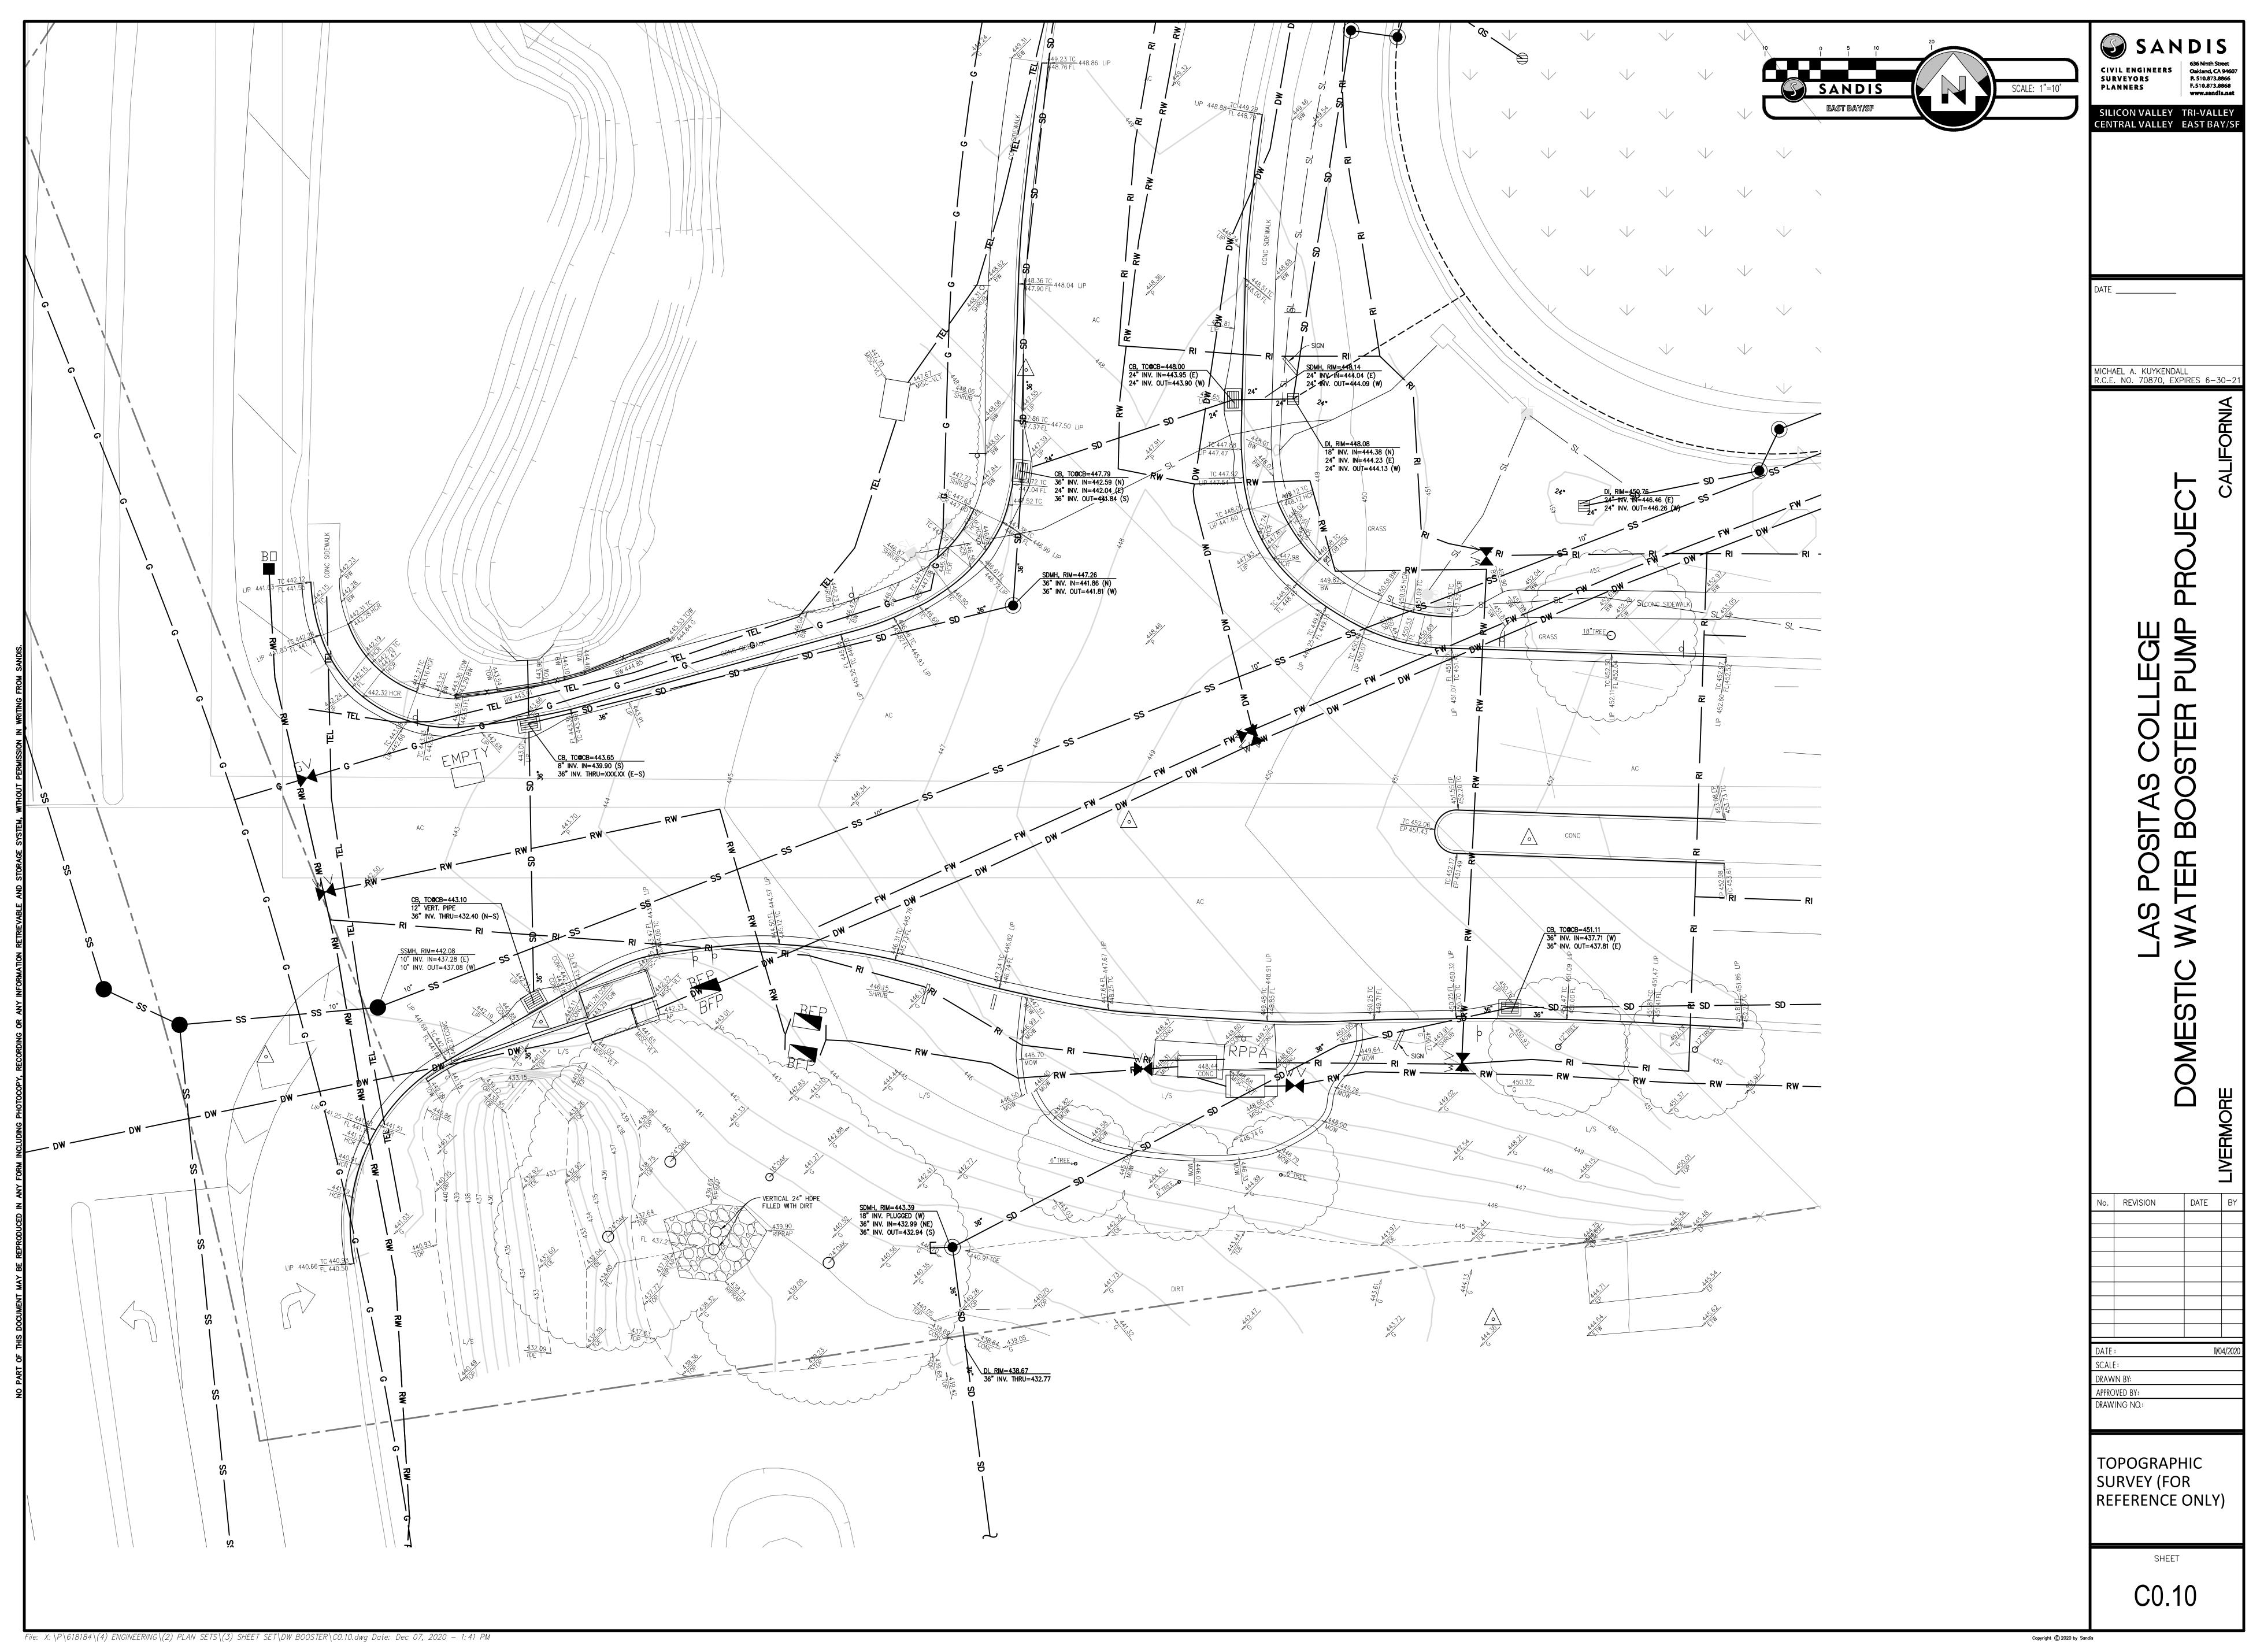


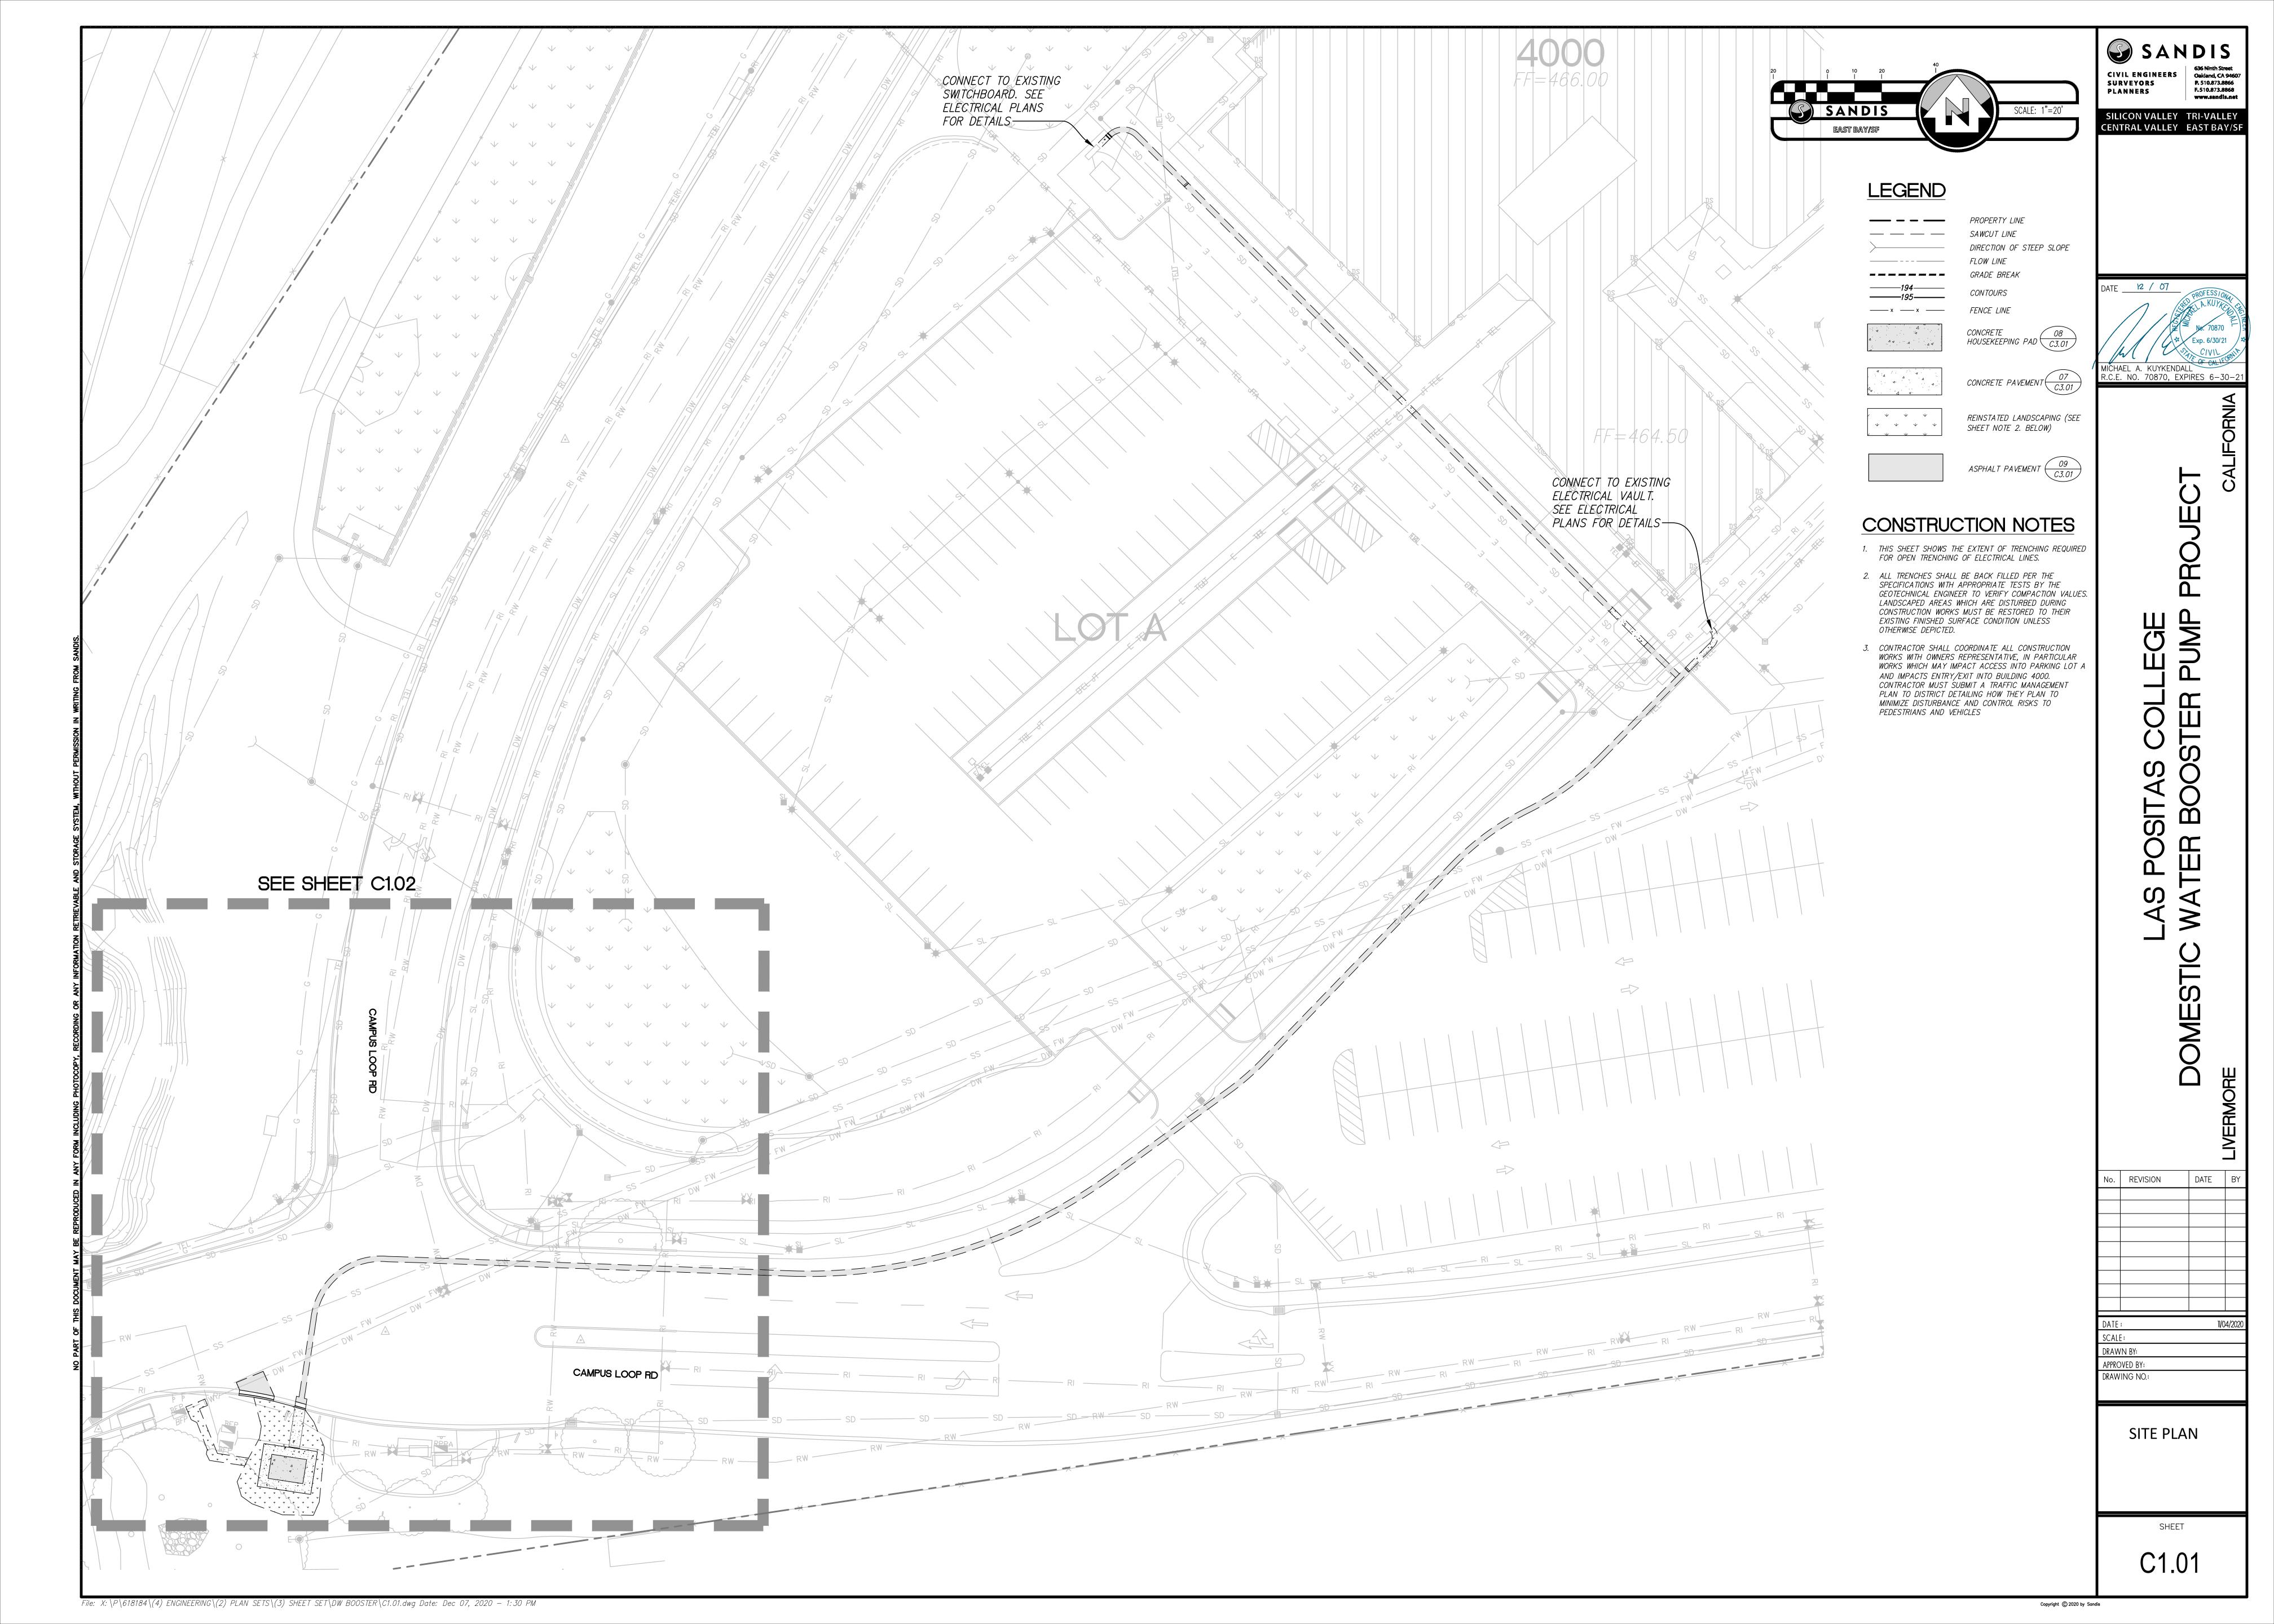

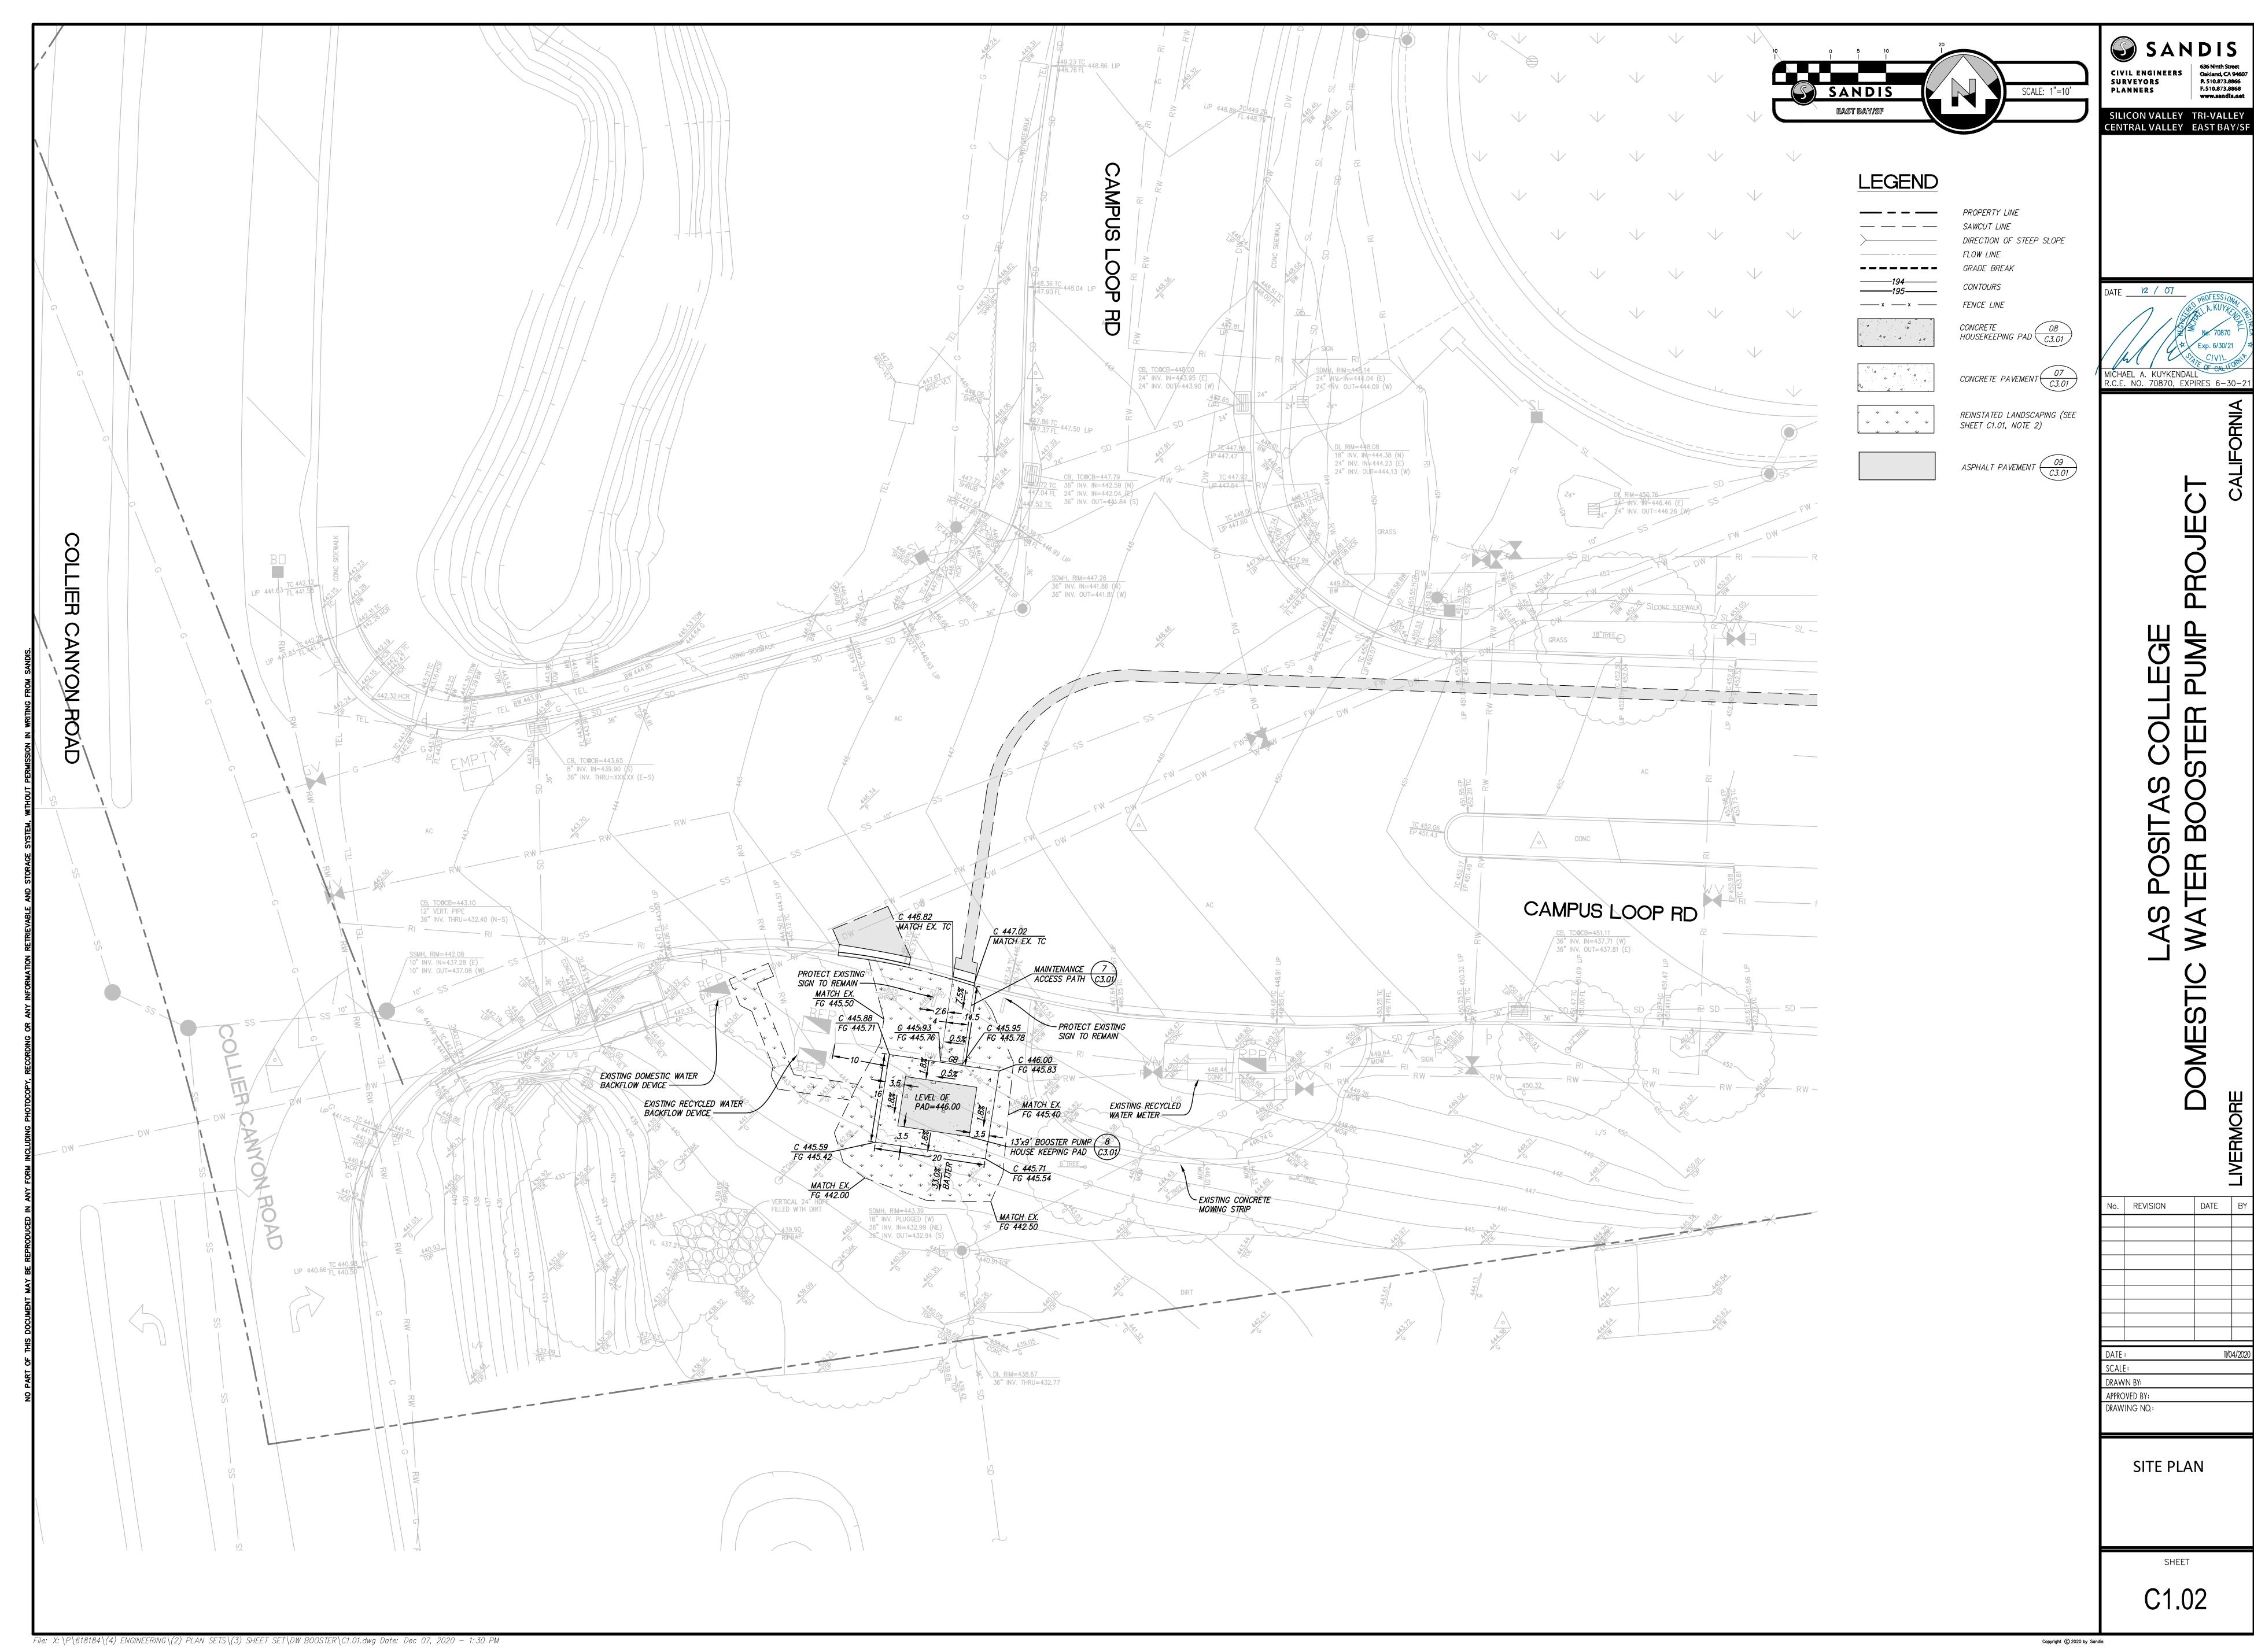


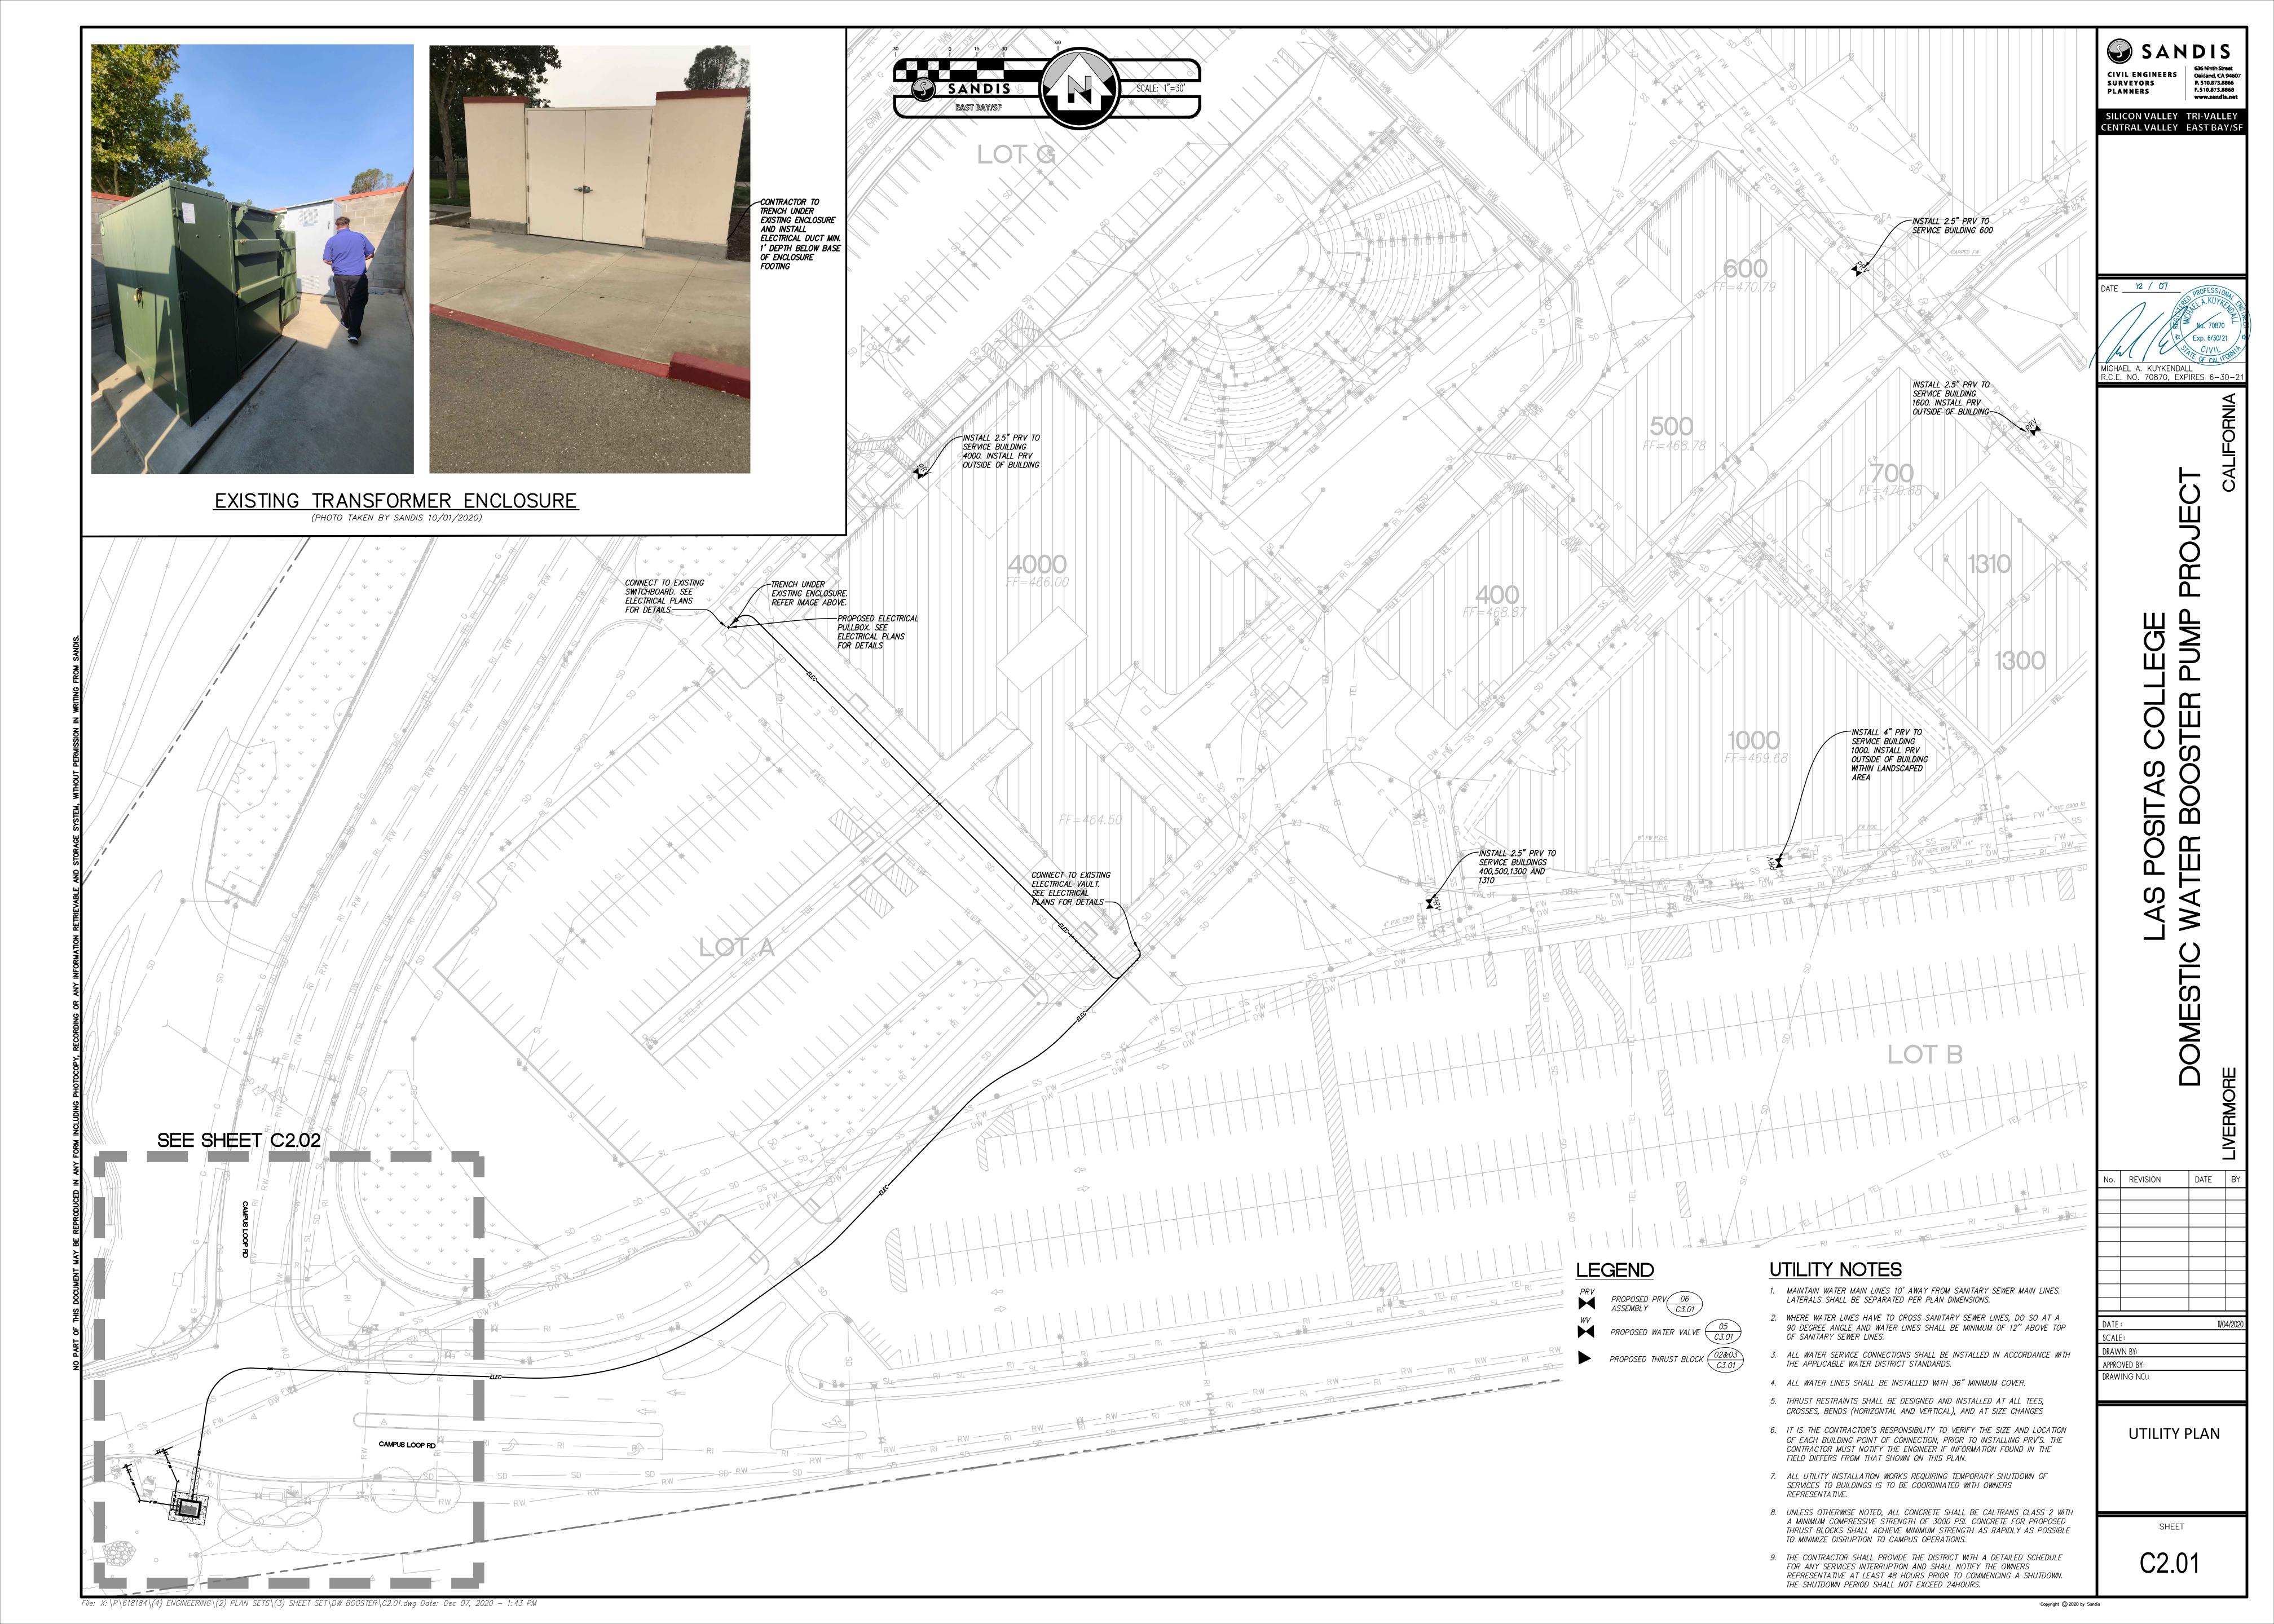

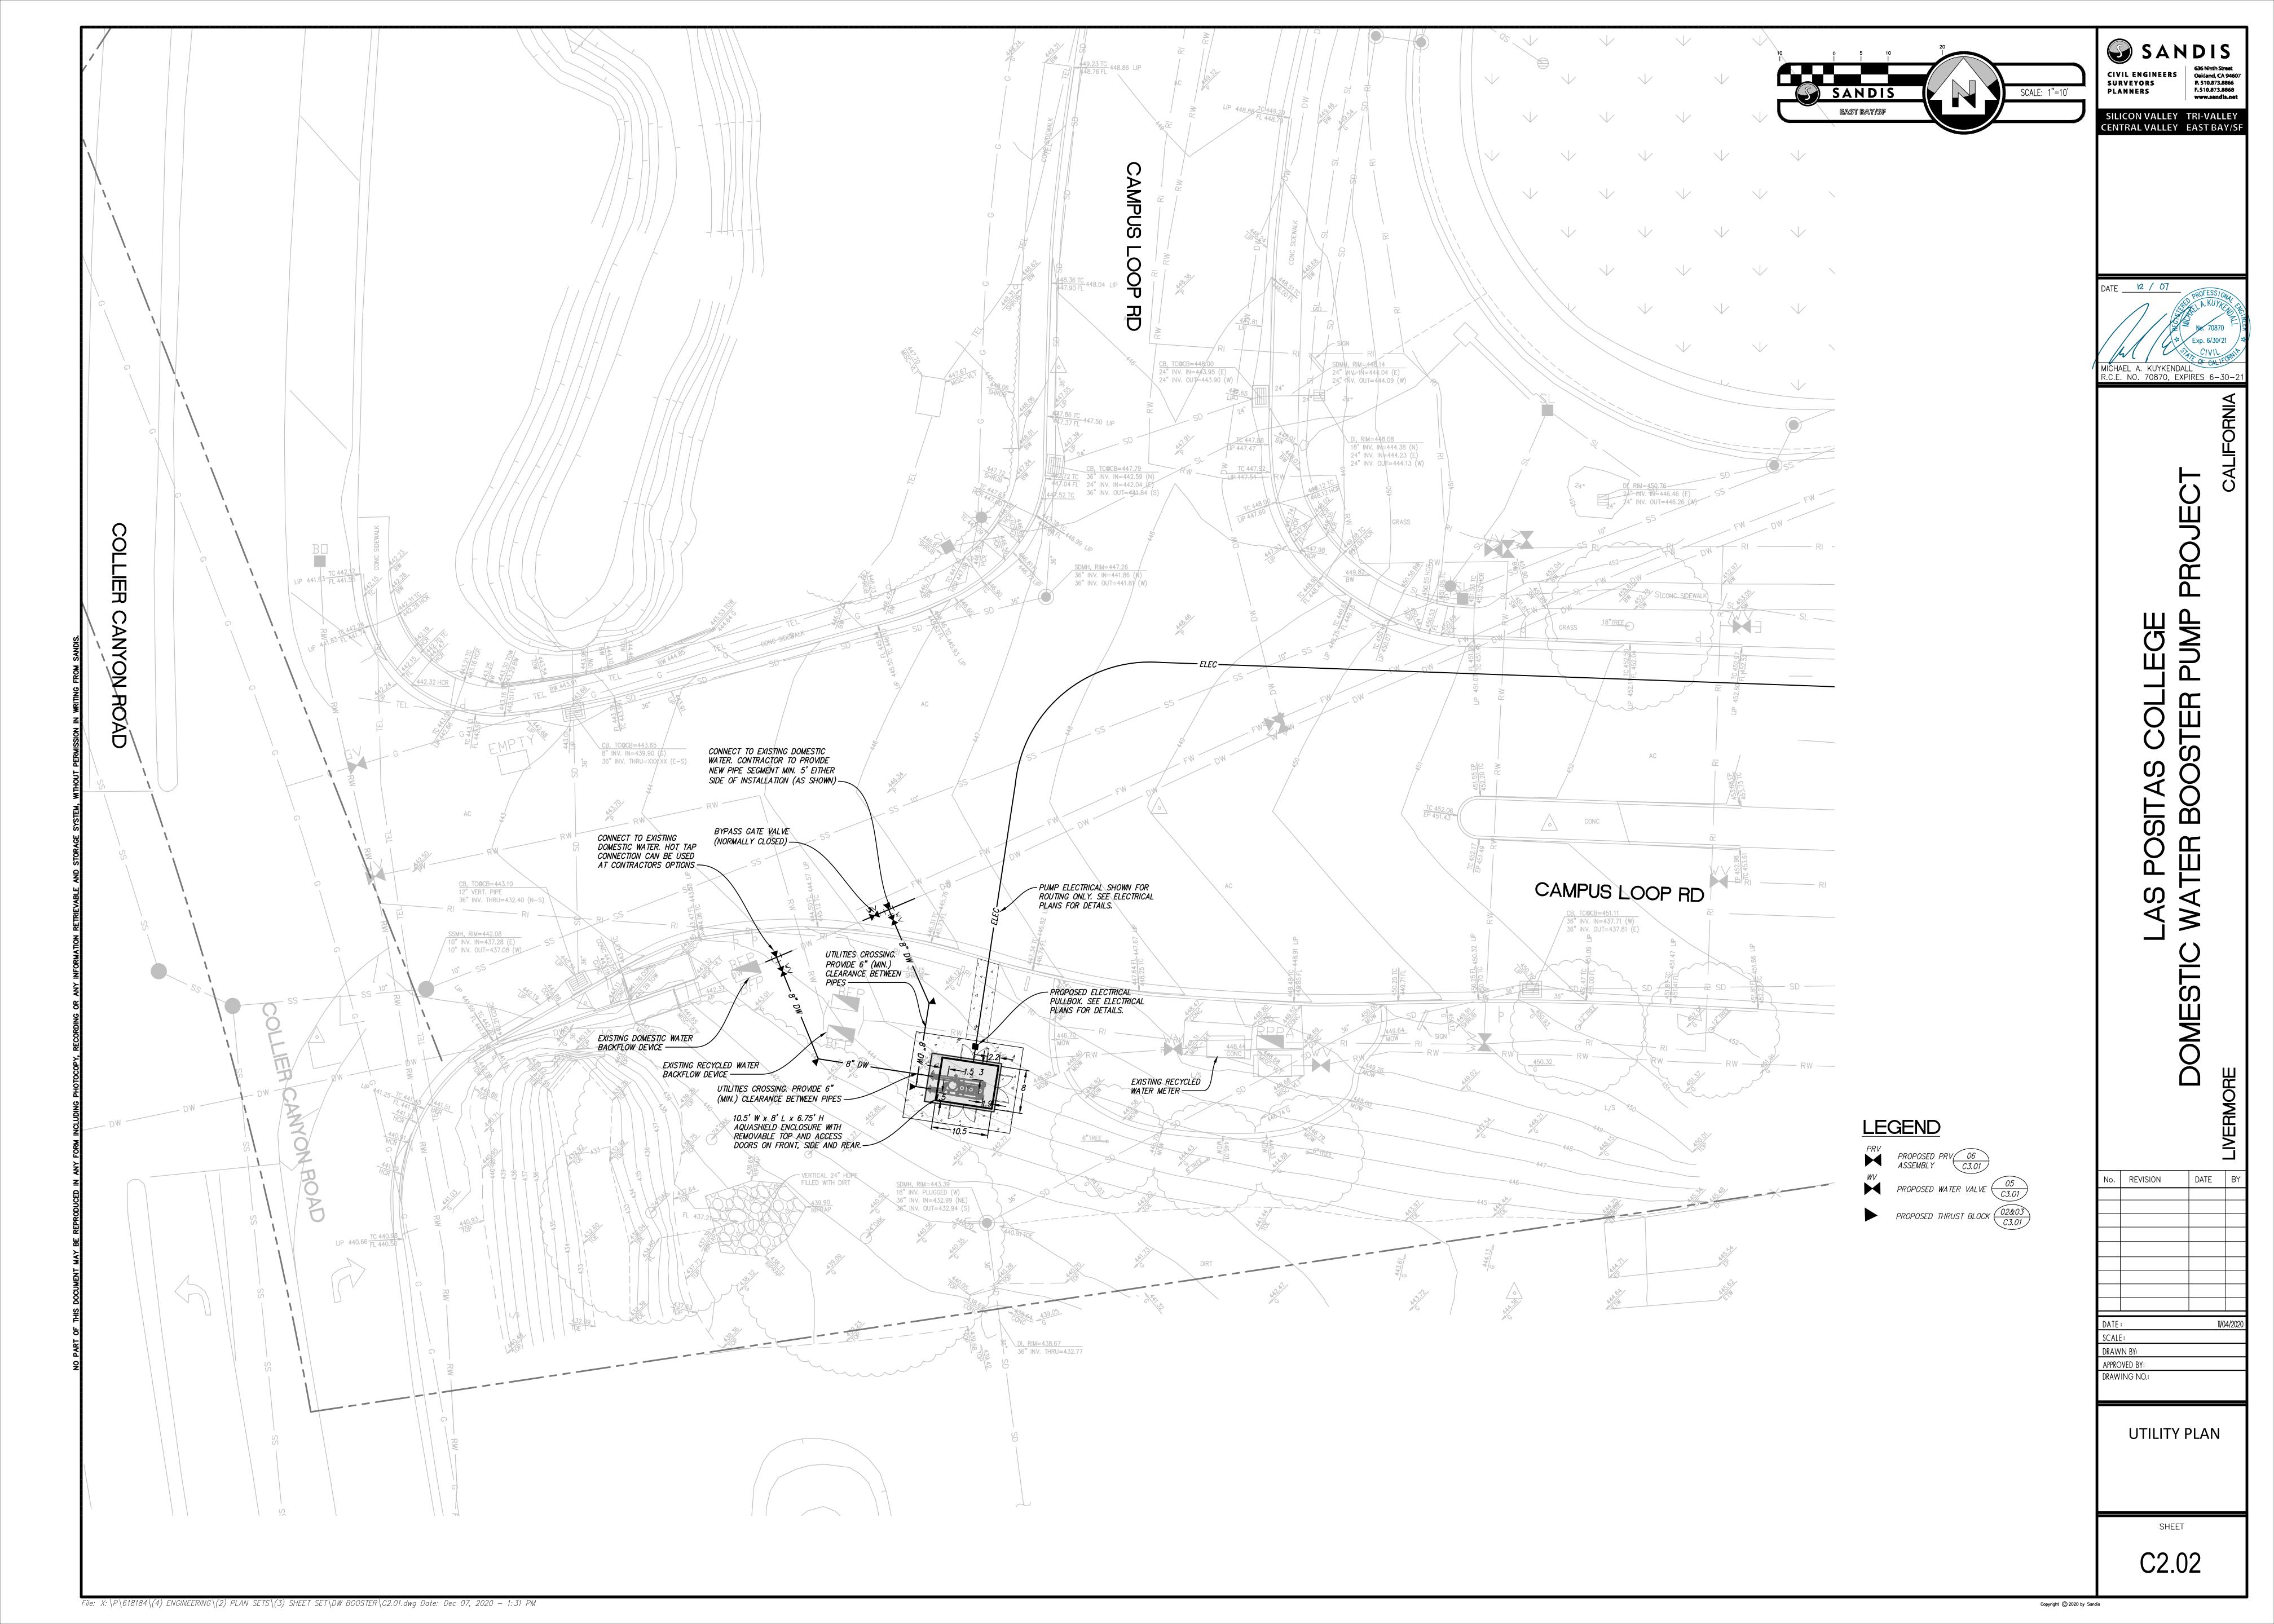

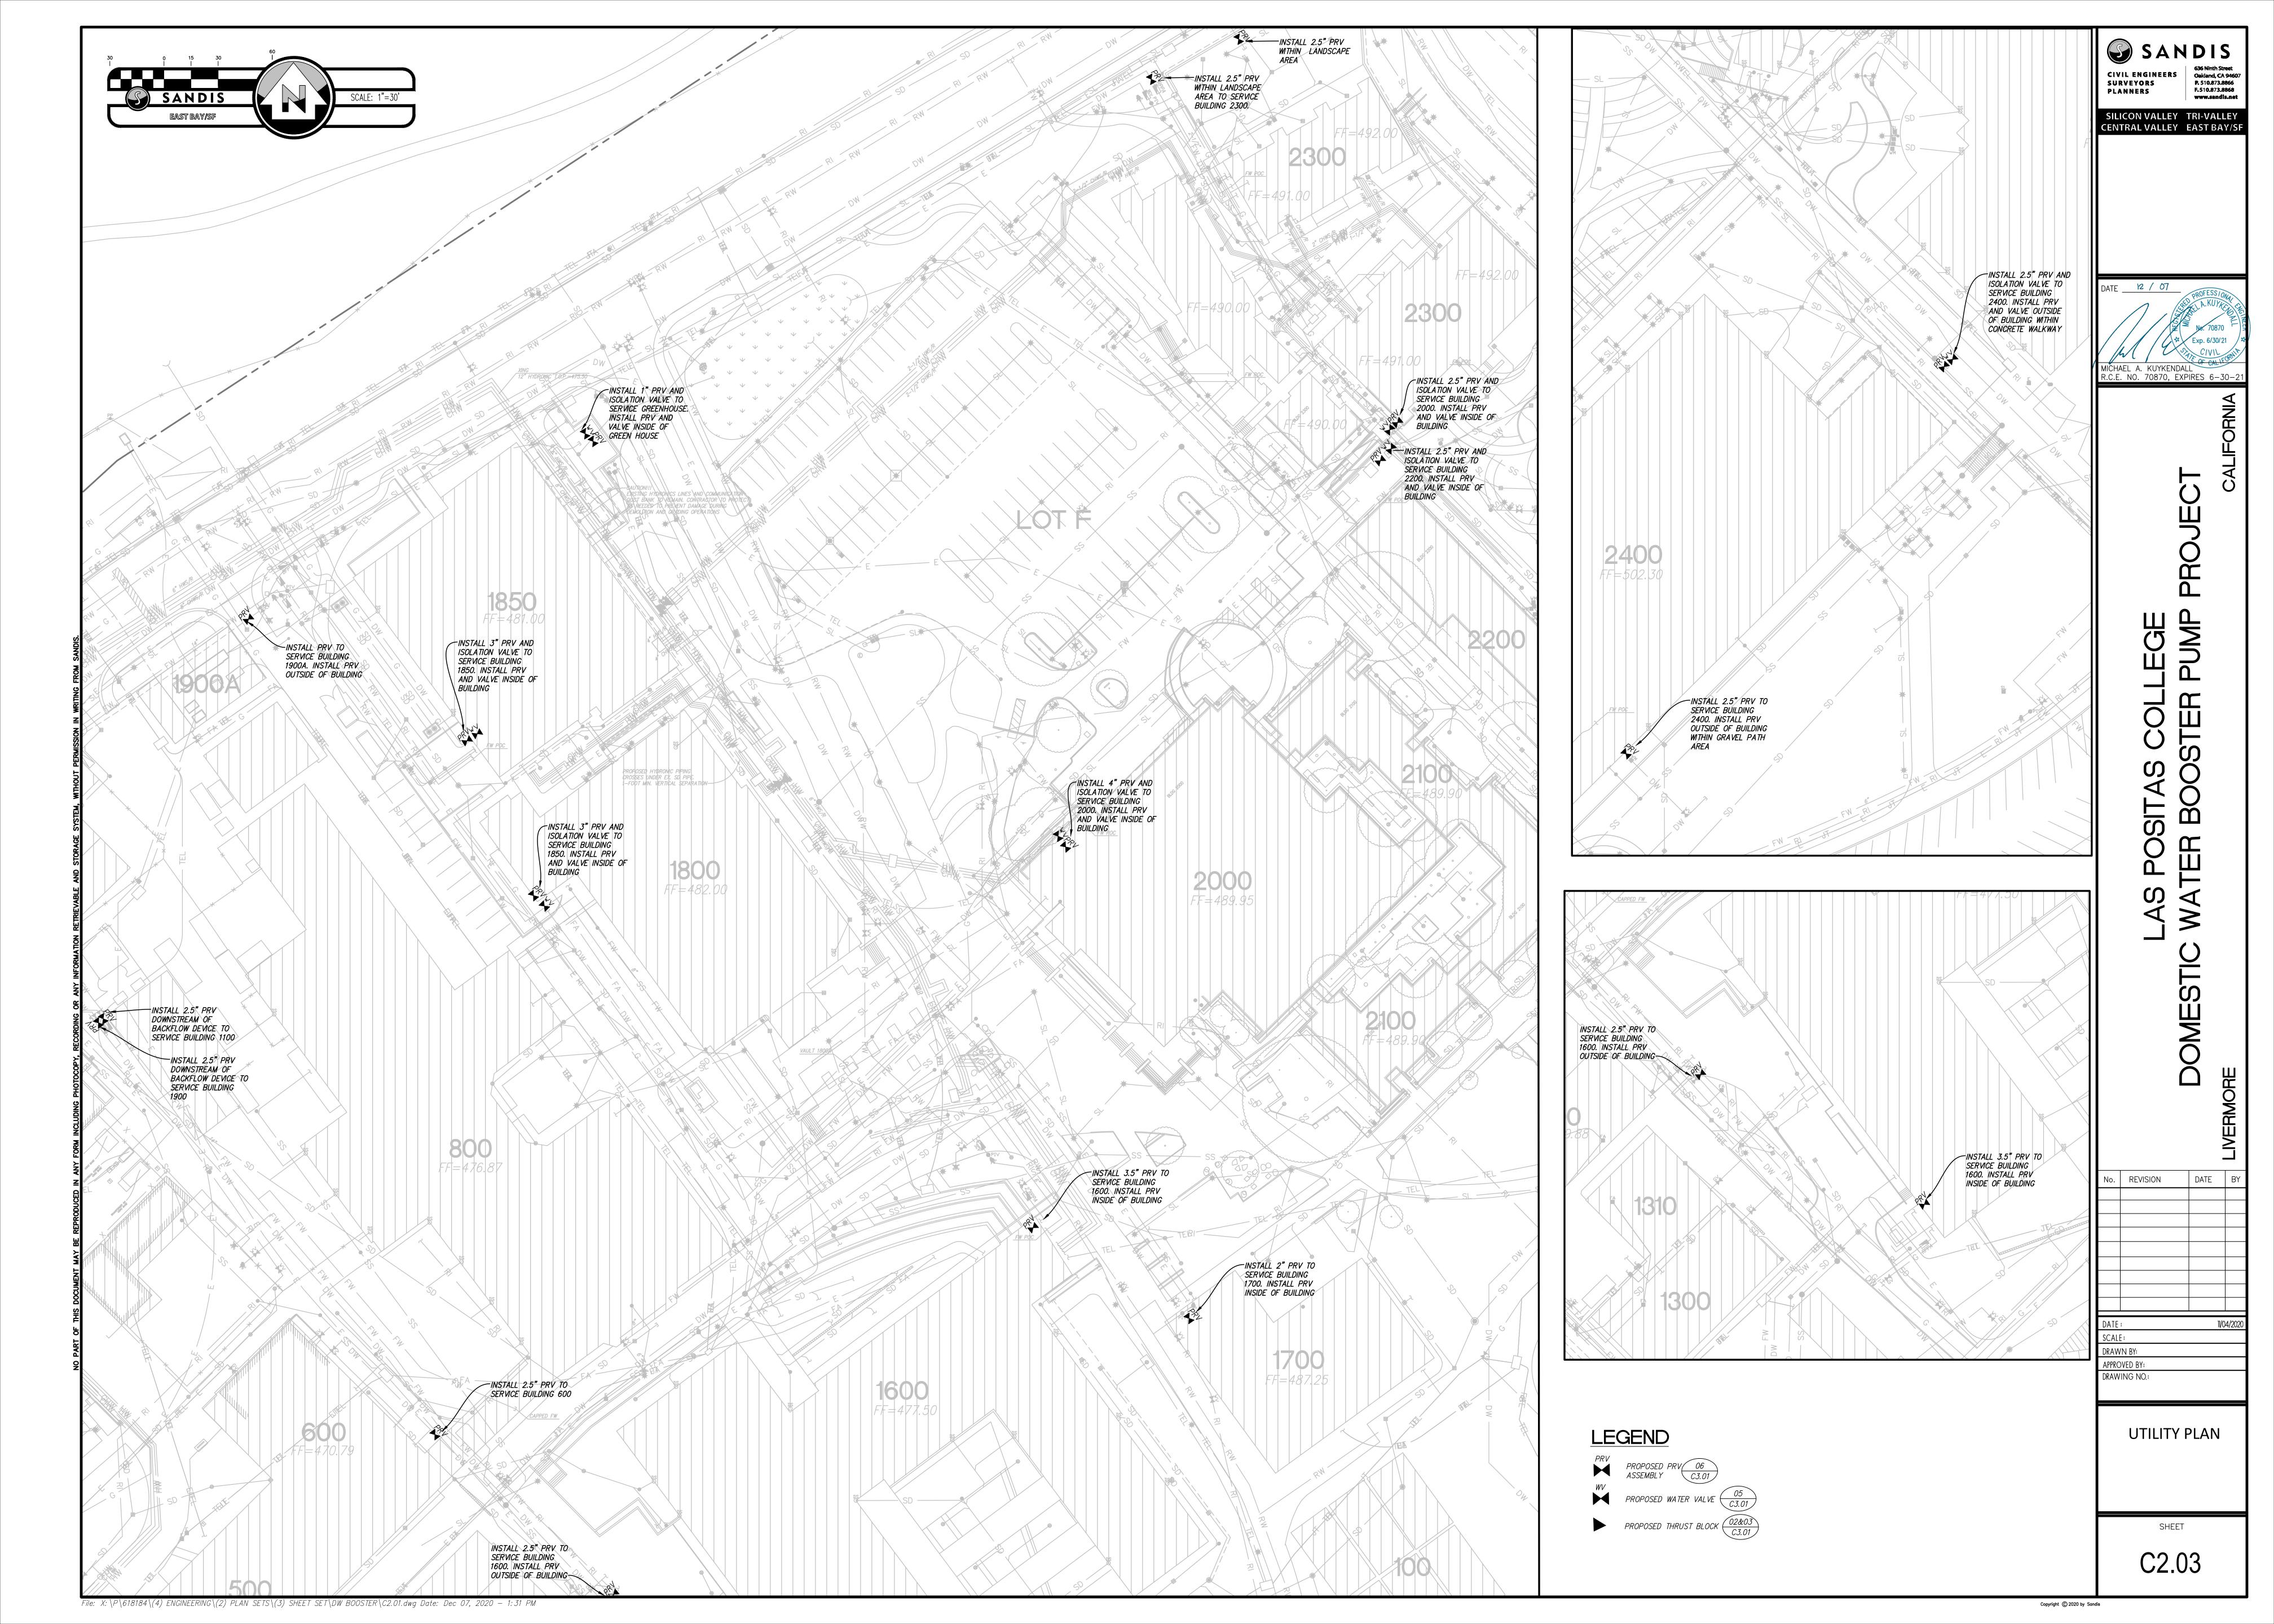

PER CBC CHAPTER 11B THE SLOPE OF THE GUTTER PAN SHALL NOT EXCEED 5% AT ACCESSIBLE RAMPS. CURB REINSTATEMENT DETAIL

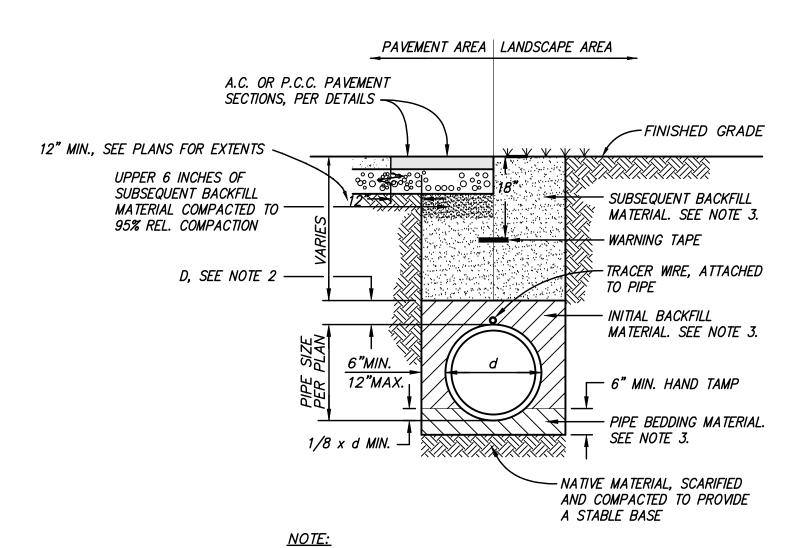

1. PLACE CUT OFF PLUG OF IMPERMEABLE MATERIAL WHERE ALL TRENCHES ENTER A PAVEMENT AREA. 2. D=6" MIN. FOR PIPE SIZES ≤ 12 INCHES

D=12" MIN. FOR PIPE SIZES > 12 INCHES 3. COMPACT BACKFILL AND BEDDING MATERIALS TO THE FOLLOWING PERCENT RELATIVE COMPACTION: 4. ALL TRENCHES SHOULD BE RESTORED TO THE EXISTING FINISH CONDITION UNLESS OTHERWISE


COMPACTION REQUIREMENTS					
	TRENCH SAND	TRENCH GRAVEL	APPROVED NATIVE	IMPORTED FILL	CLASS II AGGREGATE BASE
SUBSEQUENT BACKFILL MATERIAL (UNDER PAVEMENT)	N/A	N/A	95%	95%	95%
SUBSEQUENT BACKFILL MATERIAL (IN LANDSCAPE)	N/A	N/A	90%	90%	85%
INITIAL BACKFILL MATERIAL	90%	90%	N/A	N/A	N/A
BEDDING MATERIAL	95%	95%	N/A	N/A	N/A

TRENCH DETAIL (

		Т	HRUST B	LOCK TA	BLE	
	E OF TING	90° BEND & BURIES	45° BEND	22 1/2° BEND	11 1/4° BEND	TEE OR DEAD END
PL	ICAL .AN EW					
	RI	EQUIRED BE	ARING TOTA	AL AREA IN	SQUARE FE	ET
	4"	2.6	1.4	0.8	0.4	1.9
Size	6"	5.3	2.9	1.5	0.8	3.8
	8"	9.1	5.0	2.6	1.3	6.5
Pipe	10"	13.7	7.5	3.8	1.9	9.7
	12"	19.4	10.5	5.4	2.7	13.7


THRUST BLOCK NOTES

- 1. Thrust blocks to be constructed of 2500 Class 3 Caltrans concrete. 2. Blocks to be poured against undisturbed soil.
- 3. Joints to be kept free of concrete. Allow working room.
- 4. Abrupt changes in vertical alignment shall be anchored per gravity
- 5. Areas given are for PVC C900 class 200 pipe at a static test pressure of 200 psi in soil with 2,000 psf bearing capacity. Subject to field conditions.
- 6. Tapping sleeves shall have thrust blocks sized the same as tees.

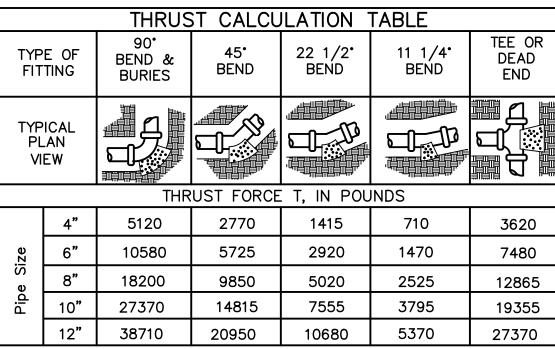


THRUST CALCULATION NOTES


- 1. CALCULATIONS BASED ON NFPA 24, TABLE 10.6.1(a), 2016 EDITION
- 2. THRUST CALCULATED FOR 200 PSI STATIC PRESSURE

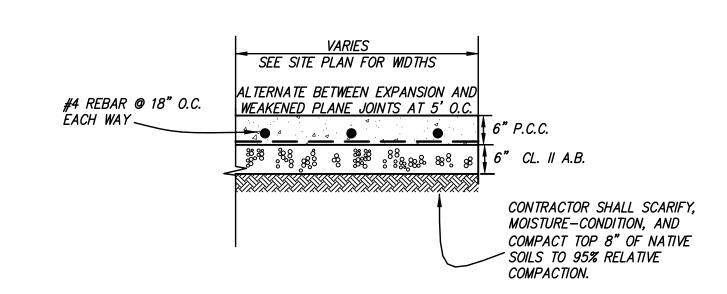


MAINTENANCE ACCESS PATH

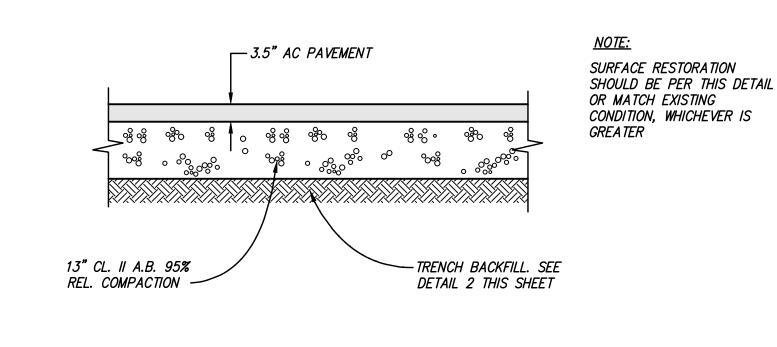



ASPHALT PAVEMENT SECTION 9

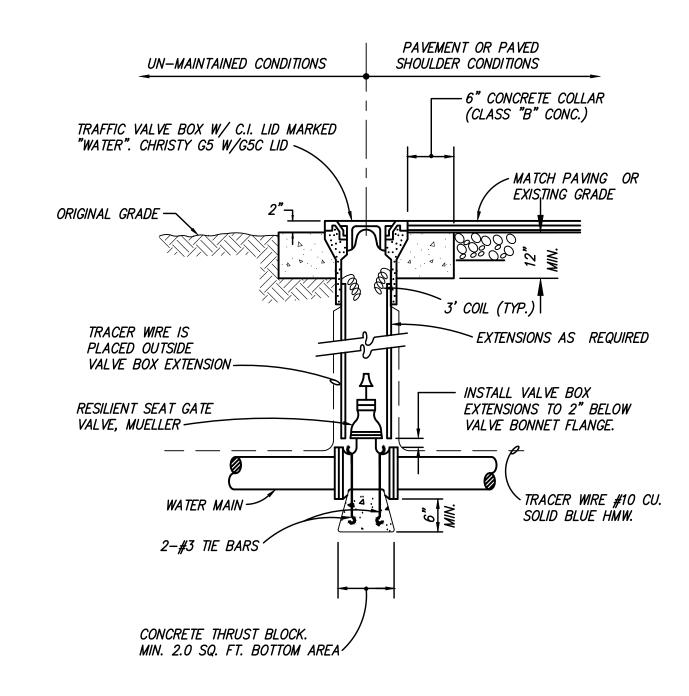



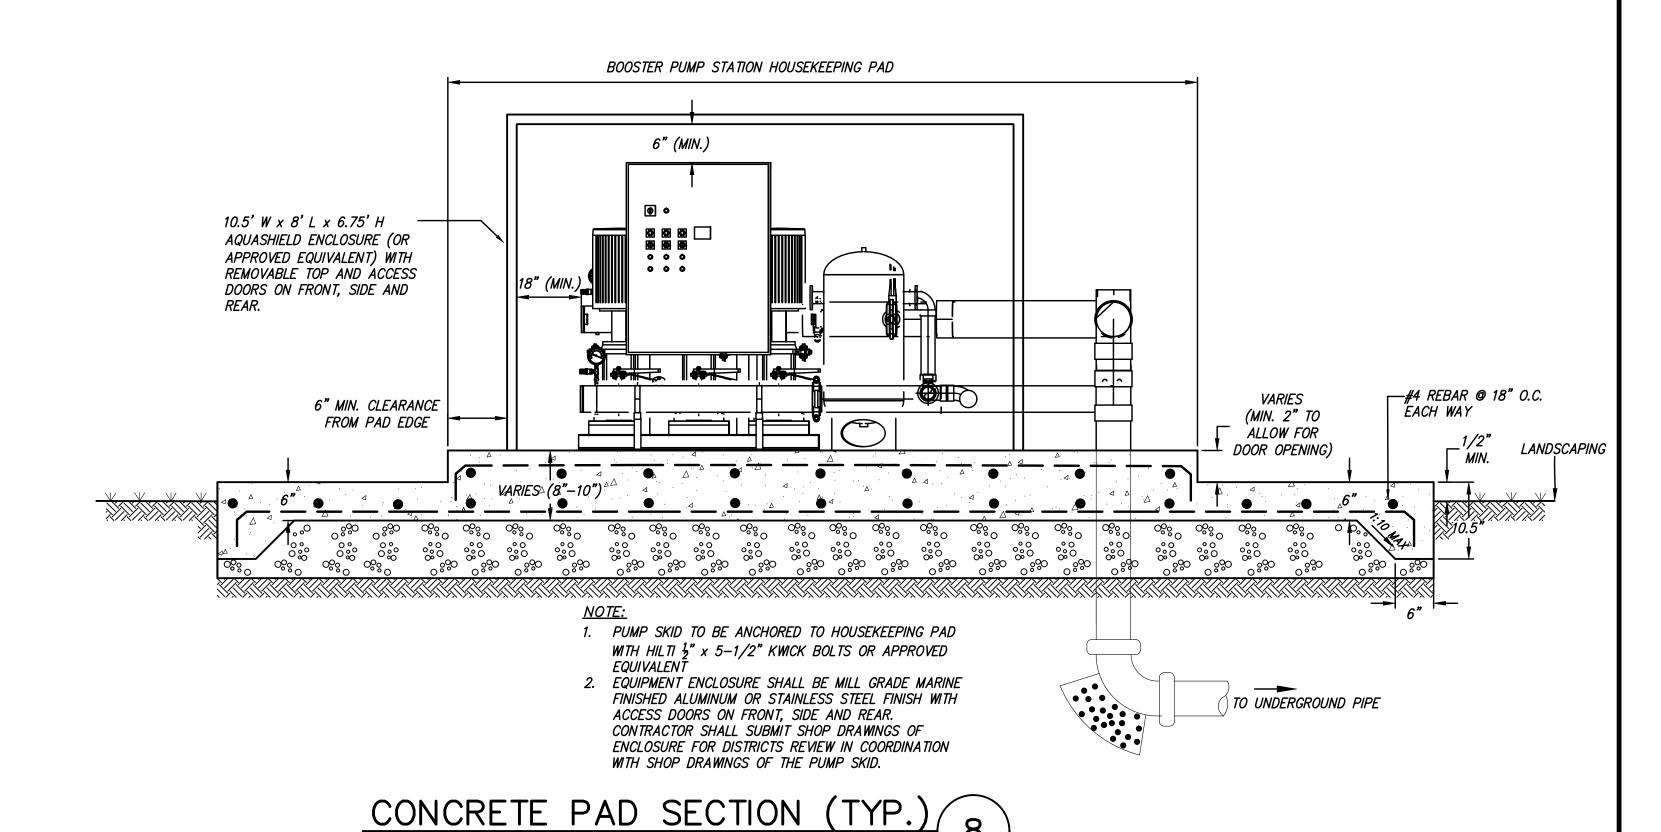

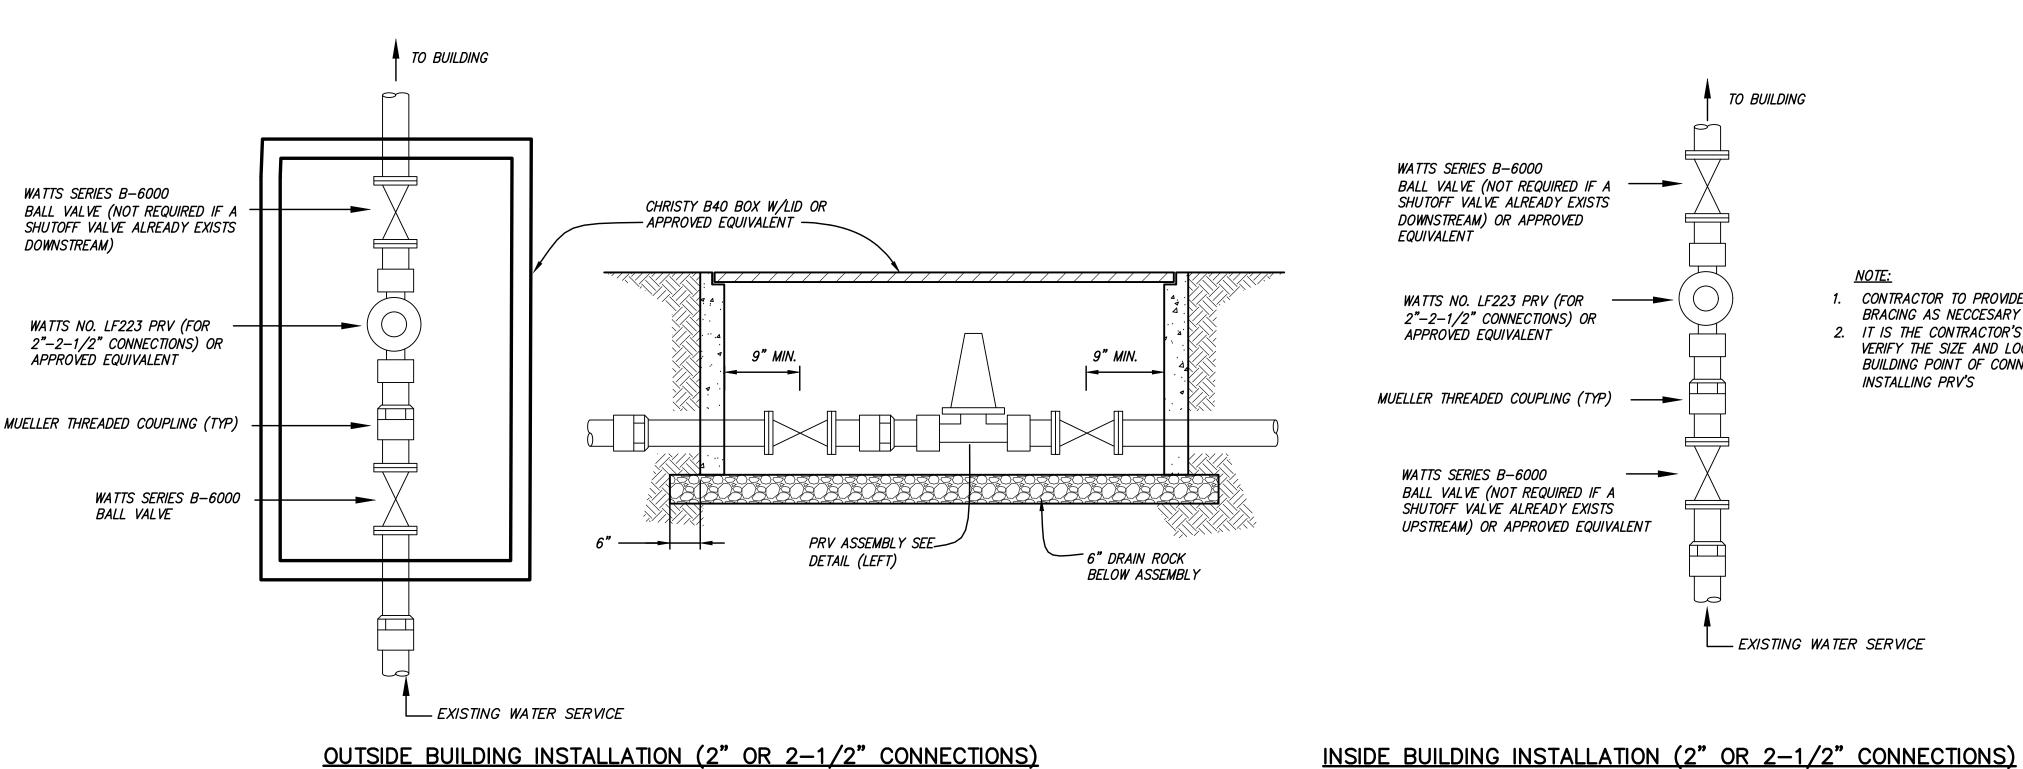

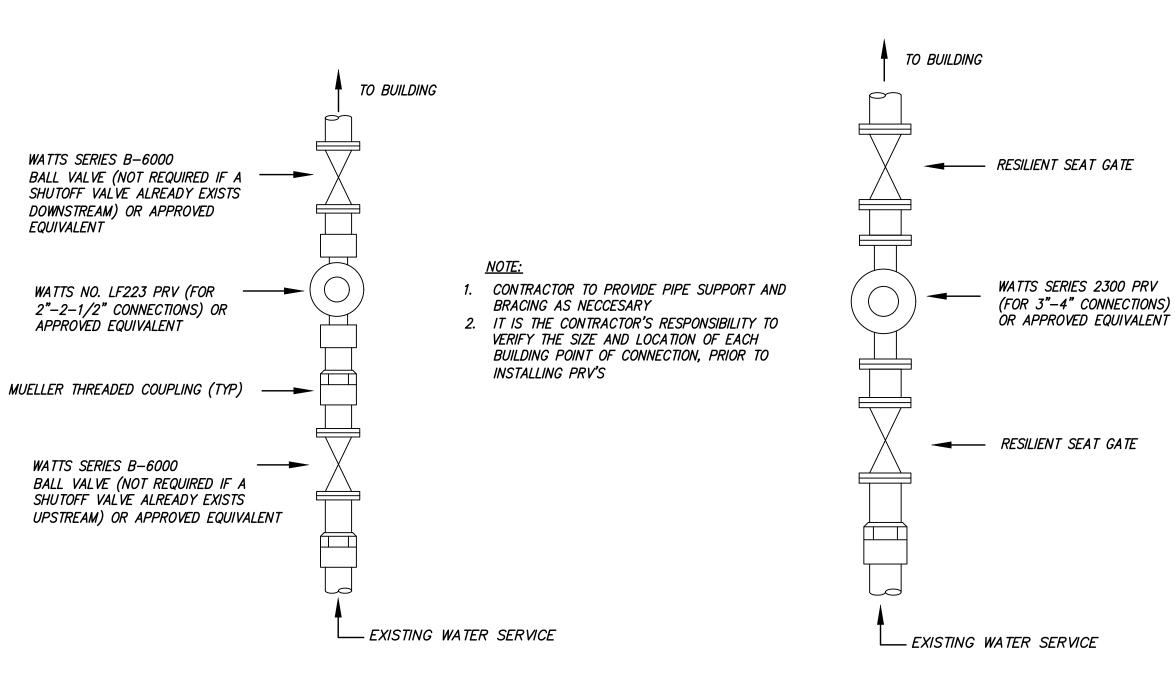

NEW PRV ASSEMBLY

INSIDE BUILDING INSTALLATION (3"-4" CONNECTIONS)

C3.01

File: X: $\P 618184 (4)$ ENGINEERING (2) PLAN SETS (3) SHEET SET DW BOOSTER C3.01.dwg Date: Dec 07, 2020 - 1:31 PM

SANDIS

CIVIL ENGINEERS Oakland, CA 94607
SURVEYORS P. 510.873.8866

SILICON VALLEY TRI-VALLEY

CENTRAL VALLEY EAST BAY/SF

F.510.873.8868

PLANNERS

DATE <u>12 / 07</u>

MICHAEL A. KUYKENDALL R.C.E. NO. 70870, EXPIRES 6-30-

DATE lo. REVISION

APPROVED BY: DRAWING NO.:

> CIVIL CONSTRUCTION **DETAILS**

SHEET

Copyright © 2020 by Sandis

	Р	LUMBING SYMBOL SCHEDU	JLE				
SYMBOL LEGEND		SYMBOL LEGEND		ABBF	REVIATION	S	
————— EXISTING PIPE	\longrightarrow	SHUT OFF VALVE, SEE SPECIFICATIONS FOR VALVE TYPE	AAP	AREA ALARM PANEL (MED. GAS)	LA	LAB AIR	7
— — — — — EXISTING PIPE, FIXTURE OR EQUIPMENT TO BE REMOVED	——————————————————————————————————————	BUTTERFLY VALVE	AD	AREA DRAIN	LAV	LAVATORY	
· · · · · · · · · · · · · · · · · · ·		GLOBE VALVE	AFF	ABOVE FINISHED FLOOR	LB	POUND	
COLD WATER PIPING	<u>π</u>	BALL VALVE	AP	ACCESS PANEL	LV	LAB VENT	
			ARCH	ARCHITECTURAL	LVAC	LAB VACUUM	
GENERAL NOTES		CHECK VALVE	AS	AUTOMATIC FIRE SPRINKLER	LW	LAB WASTE	_
ENTIRE INSTALLATION SHALL CONFORM TO THE REQUIREMENTS OF THE PLUMBING CODE,	<u> </u>	ANGLE VALVE	AV	ACID VENT	MA	MEDICAL AIR	_
BUILDING CODE, NATIONAL FIRE PROTECTION CODE, AND ALL OTHER APPLICABLE CODES AND REGULATIONS AS CURRENTLY ADOPTED BY AUTHORITY HAVING JURISDICTION.	<u> </u>	TEMPERATURE AND PRESSURE RELIEF VALVE	AW	ACID WASTE	MAI	MEDICAL AIR INTAKE	_
2. COORDINATE PLUMBING SYSTEMS WITH WORK OF OTHER TRADES PRIOR TO ANY FABRICATION	<u></u>	TEMPERATURE AND PRESSURE RELIEF VALVE	BFF	BELOW FINISHED FLOOR	MAP	MASTER ALARM PANEL (MED. GAS)	_
OR INSTALLATION. PROVIDE ALL FITTINGS, OFFSETS AND TRANSITIONS AS REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.		BALANCING VALVE	BFG	BELOW FINISHED GRADE	MAX	MAXIMUM TUOLIOANID DTU DED LIQUID	\dashv
3. PLATFORMS, CURBS AND FLASHINGS FOR PLUMBING EQUIPMENT SHALL BE AS INDICATED ON THE CIVIL PLANS, UNLESS NOTED OTHERWISE. COORDINATE EXACT SIZES OF REQUIRED OPENINGS	——————————————————————————————————————	GAS COCK VALVE	BHP	BRAKE HORSEPOWER	MBH	THOUSAND BTU PER HOUR	_
AND SUPPORTS FOR FURNISHED EQUIPMENT.	<u> </u>		BV	BALANCING VALVE COMPRESSED AIR	MG	NATURAL GAS - MEDIUM PRESSURE MINIMUM	_
4. ALL EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE EQUIPMENT MANUFACTURER'S RECOMMENDATIONS AND APPLICABLE CODES. PROVIDE ALL FITTINGS,	RPBP	REDUCED PRESSURE BACKFLOW PREVENTER	CA CD	COMPRESSED AIR CONDENSATE DRAIN	MV	MEDICAL VACUUM	
TRANSITIONS, VALVES AND OTHER DEVICES REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.		PRESSURE REGULATING VALVE	CFF	CAPPED FOR FUTURE CONNECTION	MVE	MEDICAL VACUUM EXHAUST	\dashv
5. MAINTENANCE LABEL SHALL BE AFFIXED TO ALL PLUMBING EQUIPMENT AND A MAINTENANCE	¥		CFM	CUBIC FEET PER MINUTE	N2	NITROGEN	\blacksquare
MANUAL SHALL BE PROVIDED TO OWNER'S REP. 6. PIPES SHALL BE SUPPORTED AND BRACED PER SMACNA "GUIDELINES FOR SEISMIC RESTRAINTS		PRESSURE REDUCING VALVE ASSEMBLY	CHV	CHECK VALVE	N2O	NITROUS OXIDE	
OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS." 7. HOUSEKEEPING PADS SHALL BE 6 INCHES HIGH WITH A MINIMUM OF 6 INCHES BEYOND		SOLENOID VALVE	COND	CONDENSATE	(N)	NEW .	
EQUIPMENT (INTERIOR ONLY).			CONN	CONNECTION	NC	NORMALLY CLOSED	-
		OS & Y VALVE	CONT	CONTINUATION	NO	NORMALLY OPEN	
		STRAINER	CSS	CLINICAL SERVICE SINK	NO.	NUMBER	
GENERAL SEISMIC BRACING NOTES		STRAINER WITH HOSE BIBB	CSP	COMBINATION STANDPIPE	OFD	OVERFLOW DRAIN	\exists
		HOSE BIBB	CTE	CONNECT TO EXISTING	OFCI	OWNER FURNISHED CONTRACTOR INSTALLED	
 SUPPORTS AND ATTACHMENTS OF ALL EQUIPMENT TO BE INSTALLED AS A PART OF THE PROJECT SHALL BE DETAILED ON CONSTRUCTION DOCUMENTS PER CBC 2019. 		SHOCK ABSORBER (WATER HAMMER ARRESTOR)	CU. FT.	CUBIC FEET	OS&Y GV	OUTSIDE STEM AND YOKE GATE VALVE	
2. ONCE THE EXACT LOCATIONS OF ALL PIPES, DUCTS AND CONDUITS HAVE BEEN ESTABLISHED,	T	SHOCK ABSORBER (WATER HAMMER ARRESTOR)	CU. IN.	CUBIC INCHES	PAS	PRE-ACTION AUTOMATIC SPRINKLER	
THE STRUCTURAL ENGINEER OF RECORD MUST VERIFY THE ADEQUACY OF THE SUPPORTING STRUCTURE FOR LOADS IMPOSED BY THE ANCHORAGE AND BRACING SYSTEM, TO ENSURE	FS T	FLOW SWITCH	CW	COLD WATER	PD	PUMPED DISCHARGE	
THAT THE ORIGINAL DESIGN IS ADEQUATE. THE SEOR SHALL DESIGN ANY SUPPLEMENTARY	□TS	TAMPER SWITCH	DF	DRINKING FOUNTAIN	PG	PRESSURE GAUGE	
FRAMING FOR THE INSTALLATION OF THE PRE-APPROVED SYSTEM AS NEEDED TO RESIST THE LOADS, AND/OR MAINTAIN STABILITY AS PART OF A CHANGE ORDER.		TAMPER SWITCH	DFU	DRAINAGE FIXTURE UNITS	POC	POINT OF CONNECTION	_
3. A COPY OF THE PRE-APPROVED BRACING SYSTEMS INSTALLATION MANUAL SHALL BE ON THE JOBSITE PRIOR TO STARTING THE INSTALLATION OF HANGERS AND/OR BRACES. SUBMIT	M	METER	DIA	DIAMETER	PRV	PRESSURE REDUCING VALVE ASSEMBLY	_
APPLICABLE DETAILS FOR REVIEW AND APPROVAL. 4. ALL ANCHORAGE, SUPPORT AND SEISMIC RESTRAINT WORK TO BE IN ACCORDANCE WITH THE	lacksquare	PRESSURE GAUGE	DI	DEIONIZED WATER	PSI	POUNDS PER SQUARE INCH	_
APPROVED LOCAL REQUIRMENTS.			DW	DISHWASHER	PWR	PURE WATER RETURN	_
	<u> </u>	THERMOMETER	(E)	EXISTING	PWS	PURE WATER SUPPLY	_
		FLEXIBLE CONNECTION	EEW	EMERGENCY EYE WASH	R	RELOCATE OR RELOCATED	_
	——————————————————————————————————————	UNION	ESH	ELEVATION EMERGENCY SHOWER	RD ROS	ROOF DRAIN REVERSE OSMOSIS WATER SUPPLY	_
		REDUCER	ETV	EEW/ESH TEMPERING VALVE	ROR	REVERSE OSMOSIS WATER RETURN	-
		DIRECTION FLOW	EWC	ELECTRIC WATER COOLER	RPBP	REDUCED PRESSURE BACKFLOW PREVENTER	
		PIPE UP		FIRE MAIN	RPM	REVOLUTIONS PER MINUTE	
			FCO	FLOOR CLEANOUT	S	SOIL OR WASTE	
		PIPE DOWN	FCV	FLOW CONTROL VALVE	SD	STORM DRAINAGE	\dashv
		VALVE IN VERTICAL	FD	FLOOR DRAIN	sov	SHUT-OFF VALVE IN RISER	
		PIPE CONNECTION, TOP	FHC	FIRE HOSE CABINET	SK	SINK	
			FHV	FIRE HOSE VALVE	SPD	SPRINKLER DRAIN	\exists
	_	PIPE CONNECTION, BOTTOM	FIN.FLR.	FINISHED FLOOR	ф	SQUARE FEET	
		CAPPED PIPE	FOT	FUEL OIL TANK	SQ. FT.	SQUARE FEET	
		PIPE SLEEVE	FPT	FIRE PUMP TEST	SS	SANITARY SEWER	
	•	DOINT OF CONNECTION	FS	FLOOR SINK	SSC	SURGEON'S SCRUB SINK	
		POINT OF CONNECTION	FT	FEET	SW	SOFTENED WATER	
	1	SHEET NOTE DESIGNATION	G	NATURAL GAS	TDL	TOTAL DEVELOPED LENGTH OF PIPE	_
		EQUIPMENT DESIGNATION	GAL	GALLON	TP	TRAP PRIMER	
	EQPT	EQUIPMENT	GCO	GRADE CLEANOUT	TS	TAMPER SWITCH	_
	1	NUMBER	GPM	GALLONS PER MINUTE	TW	TEMPERED WATER	_
		DETAIL REFERENCE BUBBLE DETAIL NUMBER	GV	GATE VALVE	TYP	TYPICAL	\blacksquare
	XX	SHEET BEARING DETAIL	GW	GREASE WASTE	UON	UNLESS OTHERWISE NOTED	\dashv
			GWS	GRAY WATER SYSTEM	UR	URINAL	\dashv

HOSE BIBB

HORSEPOWER HOT WATER

HOT WATER RETURN

INSTRUMENT AIR

INVERT ELEVATION

INDIRECT WASTE

INDUSTRIAL/ NON-POTABLE COLD WATER

INDUSTRIAL/ NON-POTABLE HOT WATER

INSTANTANEOUS ELECTRIC WATER HEATER

INDUSTRIAL/ NON-POTABLE HOT WATER RETURN WSFU

VENT

VENT THROUGH ROOF

WATER CLOSET WALL CLEANOUT

WATER HEATER

WET STANDPIPE

WATER HAMMER ARRESTER

WATER SUPPLY FIXTURE UNITS

ZONE VALVE BOX - MEDICAL GAS

WALL HYDRANT BOX

WASTE ANESTHETIC GAS DISPOSAL

PLUMBING DRAWING INDEX PLUMBING COVER SHEET
PLUMBING OVERALL SITE PLAN

SYSTEM-FLOW DIAGRAM BASED ON PUMP-SKID MANUFACTURER DIAGRAM

DISCHARGE HEADER

PLUMBING ENLARGED SITE PLAN AND DETAILS


PRESSURE TRANSDUCER
PRESSURE GUAGE

SANDIS CIVIL ENGINEERS

SURVEYORS
PLANNERS

636 Ninth Street
Oakland, CA 94607
P. 510.873.8866
F. 510.873.8868
www.sandis.net SILICON VALLEY TRI-VALLEY

CENTRAL VALLEY EAST BAY/SF MAZZETTI
220 MONTGOMERY STREET, SUITE 650 SAN FRANCISCO, CA 94104 | USA (T) 415 362 3266 www.mazzetti.com_ Project Number: 200-098



PROJEC

SYSTEM FLOW DIAGRAM
P0.00 NOT TO SCALE

SYSTEM-FLOW DIAGRAM BASED ON PUMP-SKID MANUFACTURER DIAGRAM

DOMESTIC DATE BY

AS INDICATED APPROVED BY: DRAWING NO.:

No. REVISION

PLUMBING COVER SHEET

SHEET

P0.00

File: X:\P\618184\(4) ENGINEERING\(2) PLAN SETS\(3) SHEET SET\DW BOOSTER\SAMPLE.dwg Date: ---




220 MONTGOMERY STREET, SUITE 650 SAN FRANCISCO, CA 94104 USA (T) 415 362 3266		
SUITE 650 SAN FRANCISCO, CA 94104 USA	MA	ZZETI
SUITE 650 SAN FRANCISCO, CA 94104 USA	220 MON	ITGOMERY STREET.
94104 USA		
94104 USA	SAN FRA	ANCISCO, CA
		•
www.mazzetti.com	` '	

- ISOLATION VALVE

BUFFER-TANK

220 MONTGOMERY STREET, SUITE 650 SAN FRANCISCO, CA 94104 USA (T) 415 362 3266 www.mazzetti.com
Project Number: 200-098



DOMESTIC


No. REVISION


APPROVED BY:

PLUMBING

ENLARGED SITE PLAN AND DETAILS

> SHEET P1.01

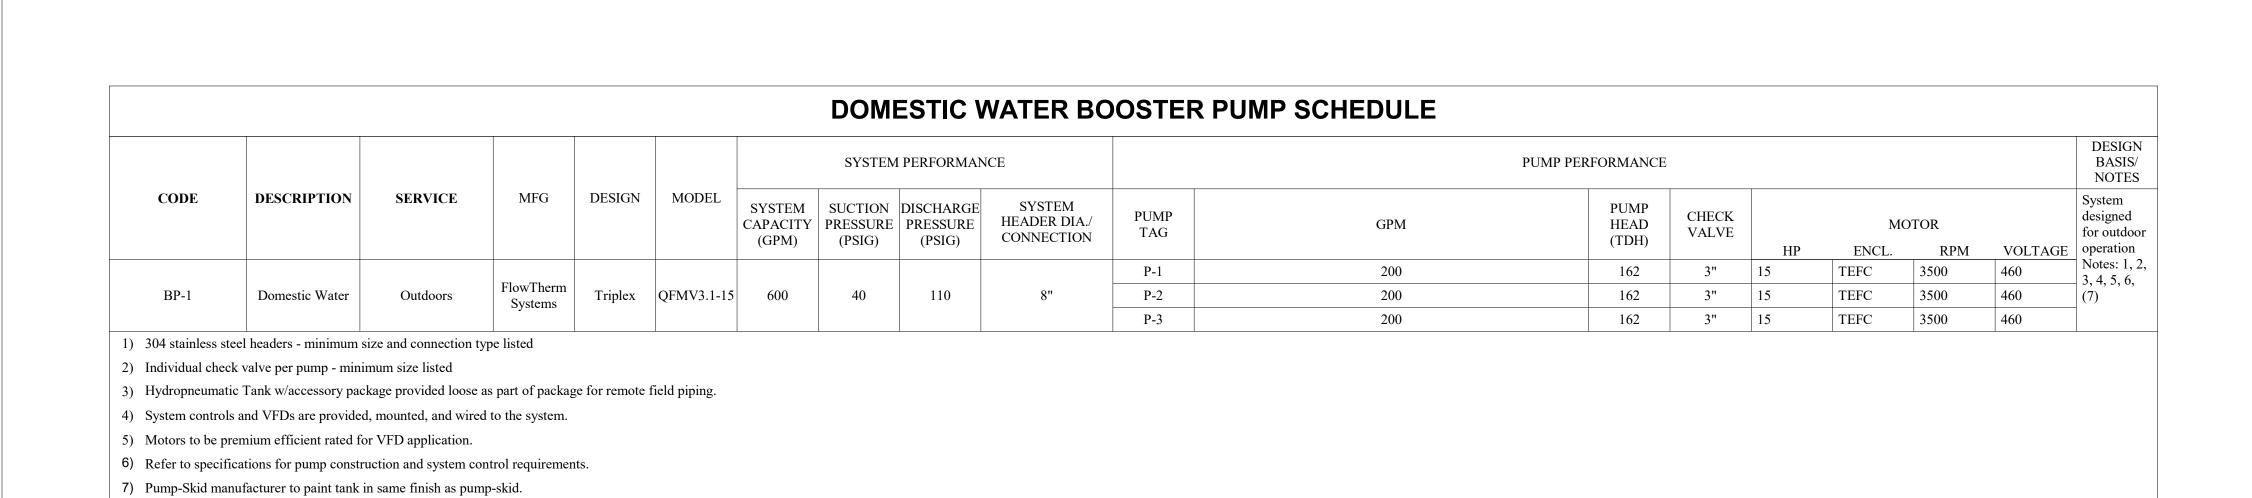

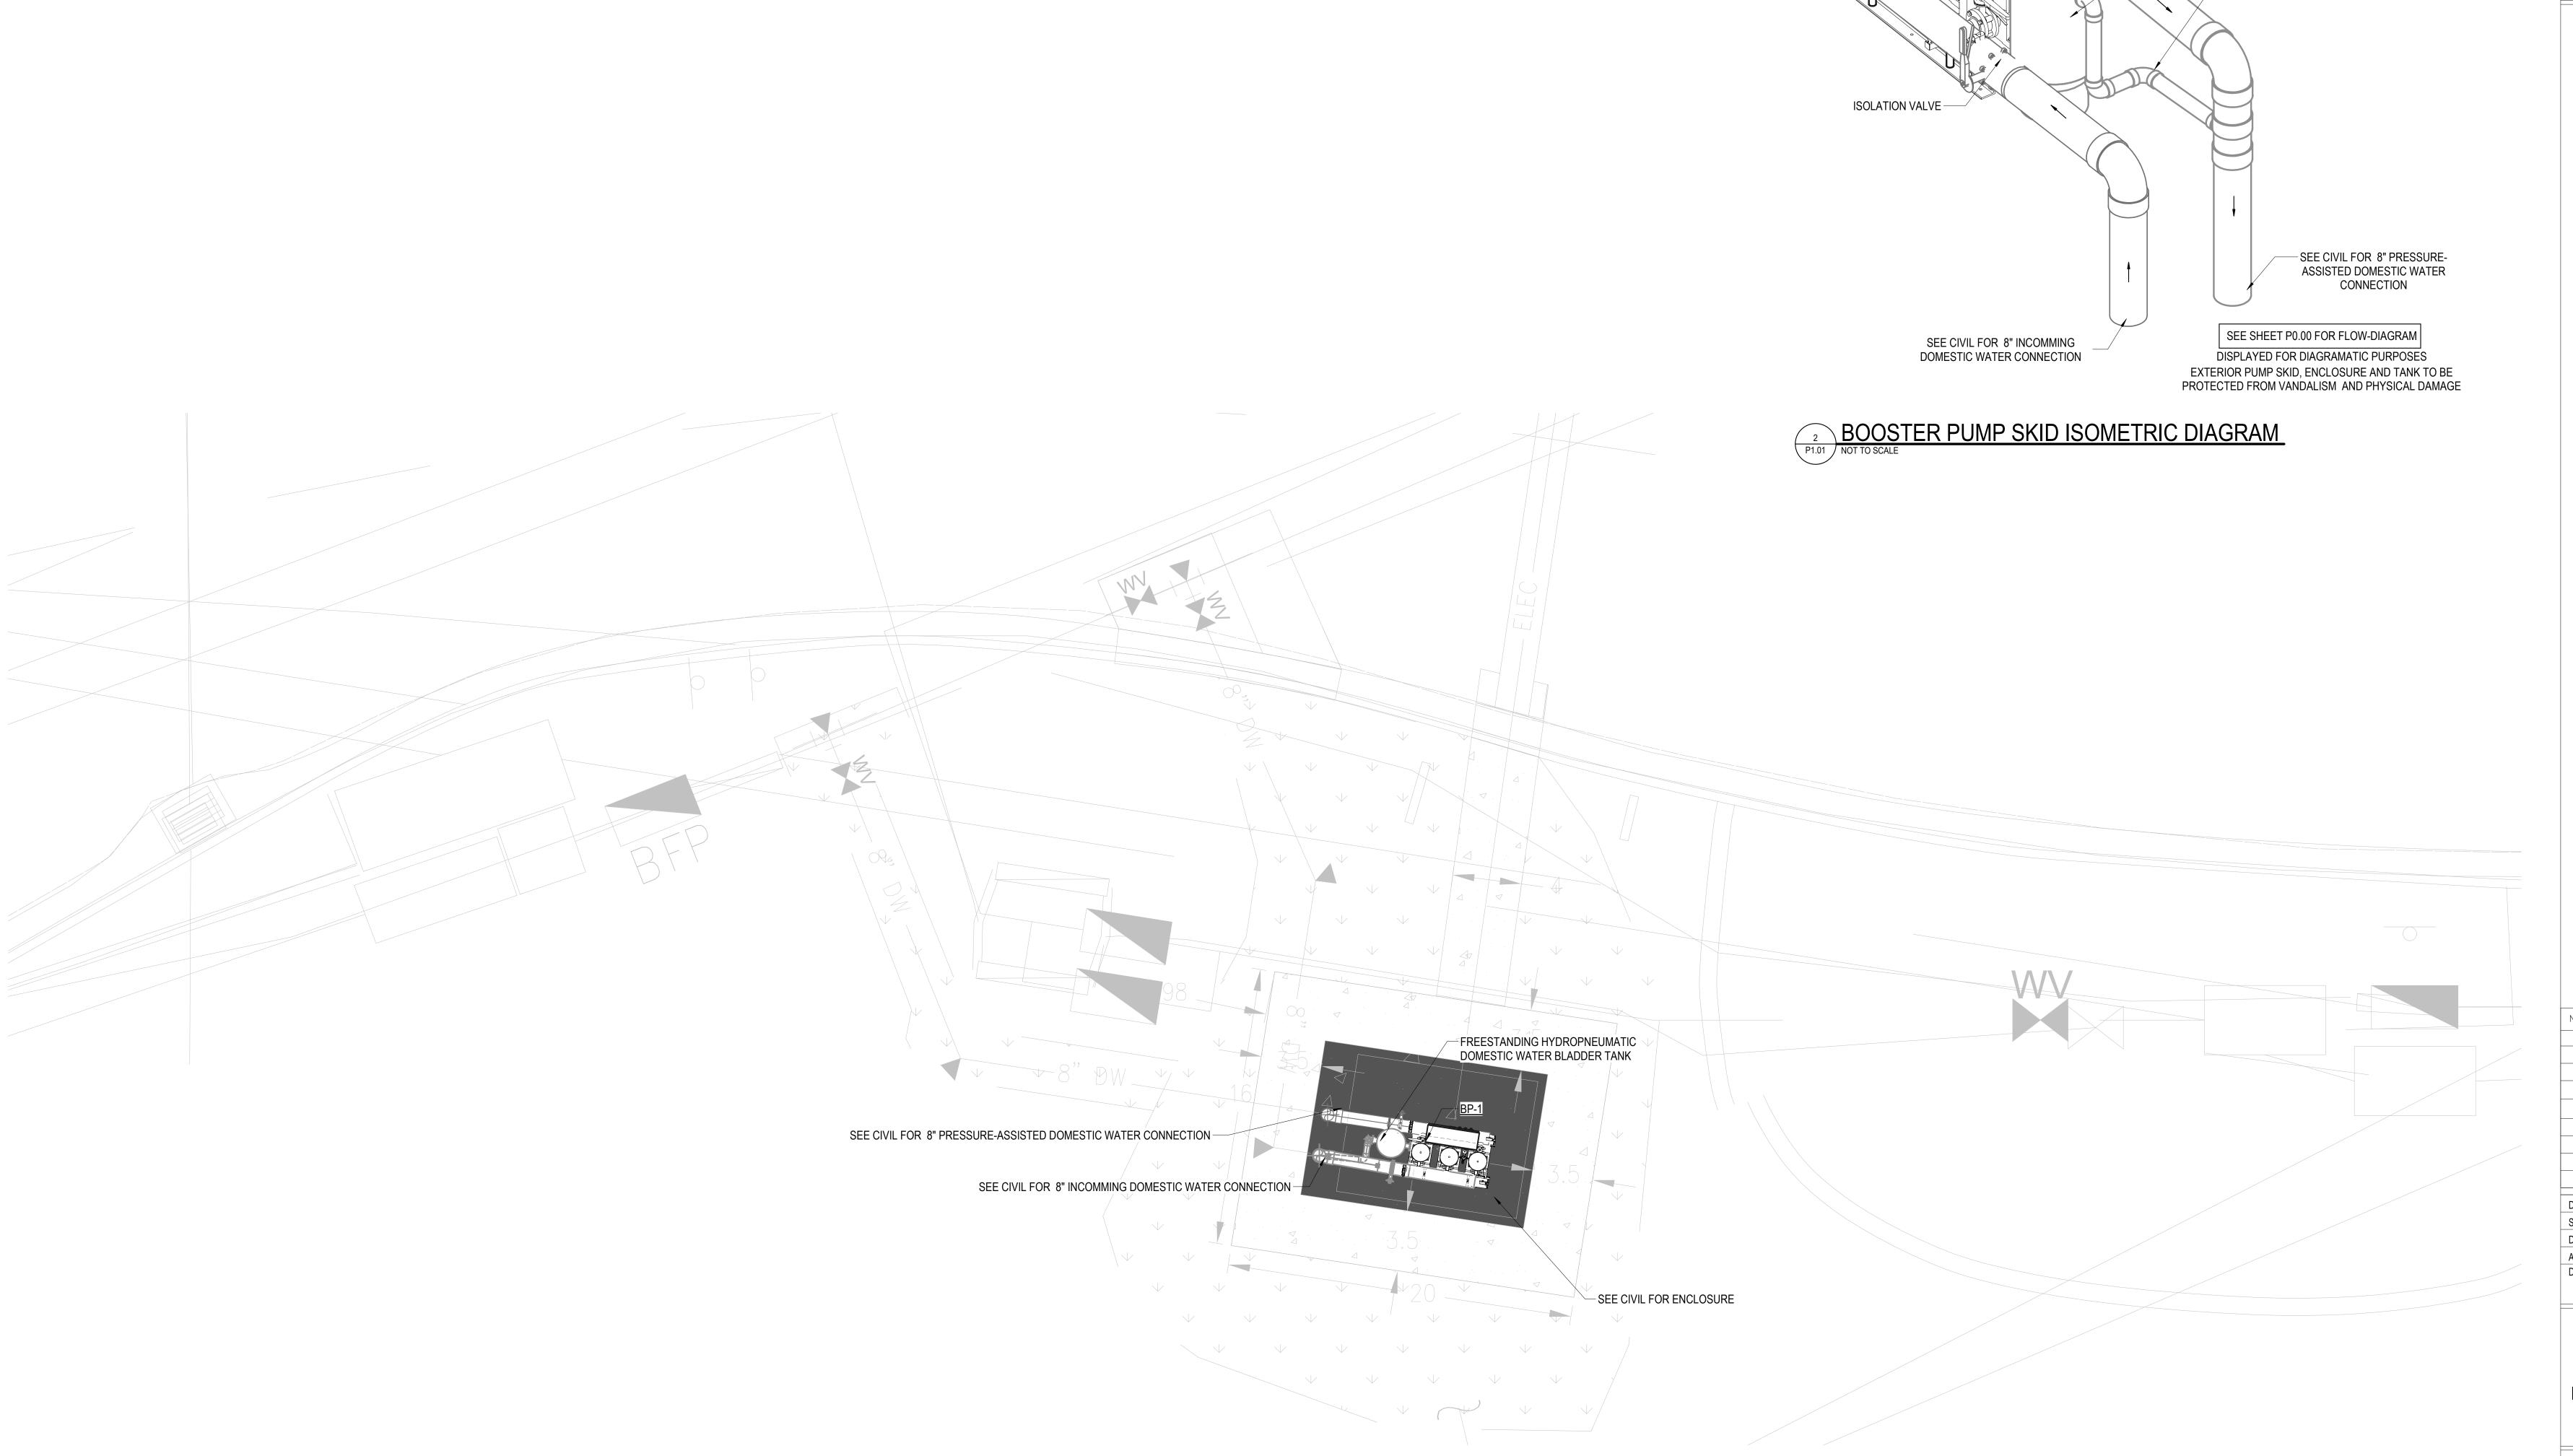

CAPPED TYP. -

File: X:\P\618184\(4) ENGINEERING\(2) PLAN SETS\(3) SHEET SET\DW BOOSTER\SAMPLE.dwg Date: ----

PLUMBING ENLARGED SITE PLAN

	11/04	1/2020
	AS INDIC	ATED
BY:		AC
/ED BY:		JA
G NO.:		

No. REVISION

ELECTRICAL COVER SHEET

SHEET

E0.00

ELECTRICAL SYMBOL SCHEDULE

	DESIGNATION SYMBOLS	
1	KEY NOTE TAG	
A • E1.1•	DETAIL REFERENCE BUBBLE - DETAIL NUMBER - SHEET BEARING DETAIL	
EF 1	EQUIPMENT TAG	

	CONDUIT SYMBOLS
	CONDUIT INSTALLED CONCEALED ABOVE CEILINGS, IN WALLS IN FINISHED AREAS, OR EXPOSED IN UNFINISHED AREAS
-E-E-	SITE UNDERGROUND CONDUIT
	CONDUIT TURNING UP
	CONDUIT TURNING DOWN
	CONDUIT STUBBED OUT WITH BUSHING
	CONDUIT STUBBED OUT AND CAPPED
\sim	FLEXIBLE CONDUIT WITH SINGLE POINT OF CONNECTION AT ELECTRICAL EQUIPMENT
——G——	GROUNDING CONDUCTOR
	CONDUIT HOMERUN; ROUTE TO PANELBOARD, CABINET, OR TERMINAL BOARD INDICATED, AND TERMINATE CONDUCTORS TO CIRCUIT OVER CURRENT PROTECTIVE DEVICE

	APPLICABLE CODES
- 2017 NFPA 70, NATIONA	L ELECTRICAL CODE (NEC)

ELECTRICAL GENERAL NOTES

- ALL ELECTRICAL WORK SHALL COMPY WITH THE CURRENT APPROVED EDITION OF THE NATIONAL ELECTRICAL CODE, AS ACCEPTED AND AMENDED BY LOCAL
- WHERE GROUNDED CONDUCTORS OF DIFFERENT SYSTEMS ARE INSTALLED IN THE SAME RACEWAY, CABLE, BOX, AUXILIARY GUTTER, OR OTHER TYPE OF ENCLOSURE, EACH GROUNDED CONDUCTOR SHALL BE IDENTIFIED BY SYSTEM PER NEC ARTICLE 200.6 (D). MEANS OF IDENTIFICATION SHALL BE PERMANENTLY POSTED AT EACH BRANCH CIRCUIT PANELBOARD. PER NEC ART 210.5 (C), UNDERGROUNDED CONDUCTORS OF MORE THAN ONE NOMINAL VOLTAGE SYSTEM SHALL BE IDENTIFIED BY SYSTEM. PROVIDE MEANS OF IDENTIFICATION AS REQUIRED PER THIS ARTICLE. PER NEC ART 215.12, FEEDER IDENTIFICAITON IS REQUIRED WHEN MORE THAN ONE NOMINAL VOLTAGE SYSTEM EXISTS. PROVIDE MEANS OF IDENTIFICATION AS
- REQUIRED PER THIS ARTICLE. VERIFY FINAL PLACEMENT AND CONNECTION REQUIREMENTS PRIOR TO ROUGHING IN EQUIPMENT UTILITIES. FINAL ACCEPTANCE OF WORK IN PLACE SHALL BE SUBJECT TO APPROVAL BY OWNER'S REPRESENTATIVE. INSTALLATION APPROVAL SHALL BE BASED ON APPROVED SUBMITTAL, SHOP DRAWINGS AND LOCAL INSPECTIONS. SUBMIT RED-LINE RECORD DRAWINGS WITHIN TWO (2) WORK WEEKS OF DATE OF NOTIFICATION OF FINAL APPROVAL.

ALL WORK SHOWN ON DRAWINGS IS IN PART SCHEMATIC, INTENDED TO CONVEY

SCOPE OF WORK AND GENERAL LAYOUT. VERIFY ALL EXISTING CONDITIONS AND

- MAKE ADJUSTMENTS AS REQUIRED. ELECTRICAL DRAWINGS ARE LARGELY DIAGRAMMATIC AND, THEREFORE, REPRESENT INSTALLATION INTENT AND GUIDELINES: IT IS THE CONTRACTOR'S RESPONSIBILITY TO COVER ALL CONDITIONS ON THEIR PREPARED SHOP DRAWINGS. PROVIDE UP-TO-DATE, ACCURATE, AND LEGIBLE CIRCUIT DIRECTORY WHICH APPLIES TO PANELBOARDS AND SWITCHBOARDS AS REQUIRED BY NEC ART. 408.4 DIRECTORY SHALL BE LOCATED ON THE FACE OR ON THE DOOR OF EACH PANELBOARD OR AT EACH SWITCH ON A SWITCHBOARD. WITHIN EACH PANELBOARD PRIOR TO FINAL ACCEPTANCE OF WORK IN PLACE. LABEL ALL WIRING DEVICES WITH SOURCE PANELBOARD AND CIRCUIT NUMBER ON COVER PLATE. SEE SPECIFICATIONS. LABEL ALL NEW PANELBOARDS, SWITCHBOARDS AND MOTOR CONTROL
- CENTERS WITH ENGRAVED LAMINATED-PLASTIC NAMEPLATES MOUNTED WITH CORROSION-RESISTANT SCREWS. SEE SPECIFICATIONS. ALL INTERIOR OUTLET, JUNCTION AND PULL BOXES SHALL BE METALLIC, SIZED PER CODE FOR THE NUMBER OF CONDUCTORS THEREIN. . ALL ELECTRICAL RACEWAYS SHALL BE CONCEALED IN THE WALLS AND ABOVE SUSPENDED CEILING UNLESS OTHERWISE NOTED. ALL CONDUCTORS SHALL BE #12 AWG MINIMUM TYPE THHN/THWN UNLESS
- OTHERWISE NOTED. ALL CEILING MOUNTED ELECTRICAL DEVICES SHALL BE SUPPORTED FROM THE CEILING GRID, NOT FROM CEILING TILE. LIGHTING SHALL BE SUPPORTED FROM STRUCTURE ABOVE. ELECTRICAL PLANS ARE MOSTLY DIAGRAMMATIC. CONTRACTOR SHALL PROVIDE CONNECTIONS BETWEEN FIXTURES AND LIGHTING CONTROL DEVICES SUCH AS OCCUPANCY SENSORS, LIGHT SWITCHES, AND LIGHTING CONTROL PANEL TO PROVIDE AN OPERABLE LIGHTING SYSTEM. . IN THE EVENT OF ANY INCONSISTENCY BETWEEN ITEMS INDICATED ON THE PLANS AND/OR THE SPECIFICATIONS, THE ONE WHICH PROVIDED THE MOST
- COMPLETE WORK OR HIGHER STANDARD SHALL PREVAIL. SUPPLY AND INSTALL ALL REQUIRED SUPPORTS AND BRACING OF EQUIPMENT AND CONDUITS FOR PROPER EQUIPMENT INSTALLATIONS AND CODE COMPLIANCE. ALL EXPOSED CONDUITS SHALL BE INSTALLED AT RIGHT ANGLE TO ROOM OR STRUCTURE. EXPOSED CONDUITS SHALL BE SUPPORTED FROM BUILDING
- STRUCTURE USING APPROVED PIPE HANGERS. ALL CONDUITS SHALL BE SIZED AS PER NEC UNLESS LARGER SIZES ARE NOTED ON THE DRAWINGS. ALL CUTTING, PATCHING AND PAINTING REQUIRED FOR THE CONCEALED INSTALLATION OF CONDUITS SHALL BE PROVIDED BY THE CONTRACTOR. DO NOT CUT OR DRILL STRUCTURAL MEMBERS WITHOUT WRITTEN APPROVAL FROM STRUCTURAL ENGINEER. ALL CUTTING AND PATCHING SHALL BE NEAT, AND PATCHING SHALL MATCH ADJACENT SURFACE AS TO TEXTURE AND FINISH. ALL PENETRATIONS THROUGH FIRE RATED WALLS, FLOORS OR CEILINGS SHALL BE SEALED IN ACCORDANCE WITH A UL APPROVED SYSTEM THAT MAINTAINS THE INTEGRITY OF THE EXISTING FIRE RATING. PROVIDE AN ENCLOSURE OF EQUAL FIRE RESISTANT RATING AROUND ALL FIXTURES AND EQUIPMENT INSTALLED IN OR PENETRATING FIRE RATED SEPARATIONS. ALL DATA CABLING TO BE PROVIDED BY THE OWNERS'S IT VENDOR. COORDINATE ROUGH-IN WORK WITH OWNER'S IT VENDOR.

POWER SYMBOLS		ABBREVIATIONS			
(M)	MOTOR OUTLET	A, AMP	AMPERE	G, GND	GROUND
	FUCED DICCONNECT CMITCH	AC	ALTERNATING CURRENT	HP	HORSEPOWER
ď	FUSED DISCONNECT SWITCH SWITCH XX/XX/XX = AMP SWITCH/POLES/AMP FUSE	ACT	ABOVE COUNTER TOP	МСВ	MAIN CIRCUIT BREAKER
딘	HEAVY DUTY NON-FUSED DISCONNECT SWITCH	AIC	AMPERE INTERRUPTING CAPACITY	MLO	MAIN LUGS ONLY
	SWITCH XX/XX = AMP SWITCH/POLES	AFF	ABOVE FINISHED FLOOR	MCA	MINIMUN CIRCUIT AMPS
\boxtimes	MOTOR STARTER	AFG	ABOVE FINISHED GRADE	МОСР	MAXIMUM OVER CURRENT PROTECTION
	COMBINATION MOTOR STARTER	ATS	AUTOMATIC TRANSFER SWITCH	MV	MEDIUM-VOLTAGE
		AF	FRAME RATING IN AMPERES	(N)	NEW
S _M	MANUAL MOTOR STARTER WITH THERMAL OVERLOAD	AS	SWITCH RATING IN AMPERES	N	NEUTRAL
VFD	VARIABLE FREQUENCY DRIVE	AT	TRIP RATING IN AMPERES	NC	NORMALLY CLOSED
		AWG	AMERICAN WIRE GAUGE	NEMA	NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION
+++	AUTOMATIC TRANSFER SWITCH	С	CONDUIT	NO	NORMALLY OPEN
979	AUTOMATIC TRANSFER SWITCH WITH BY-PASS SWITCH	CFOI	CONTRACTOR FURNISHED OWNER INSTALLED	NTS	NOT TO SCALE
		CKT	CIRCUIT	OFCI	OWNER FURNISHED CONTRACTOR INSTALLED
		CL	CONNECTED LOAD	ОС	OVER CURRENT
		СР	CONTROL PANEL	PB	PULL BOX
. 45KVA	TRANSFORMER	(D)	DEMOLISH EXISTING	Ø, PH	PHASE
		DF	DEMAND FACTOR	PNL	PANEL
1		DL	DESIGN LOAD	PVC	POLYVINYL CHLORIDE CONDUIT
\mathcal{L}	TRANSFORMER	DC	DIRECT CURRENT	Р	POLE
	OF UFD LTOD	DPDT	DOUBLE POLE, DOUBLE THROW	PWR	POWER
<u>©</u>	GENERATOR OTATIONARY OIDCUIT PREAVER BATING AS QUOMAN ON BLANG	DPST	DOUBLE POLE SINGLE THROW	(R)	RELOCATE EXISTING
	STATIONARY CIRCUIT BREAKER; RATING AS SHOWN ON PLANS	DIST	DISTRIBUTION	RSC	RIGID STEEL CONDUIT
$\ll \gg$	DRAWOUT CIRCUIT BREAKER; RATING AS SHOWN ON PLANS	(E)	EXISTING TO REMAIN	SPDT	SINGLE POLE, DOUBLE THROW
\$\\ \^\\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\	SWITCH AND FUSE; RATING AS SHOWN ON PLANS	EC	EMPTY CONDUIT	SPST	SINGLE POLE, SINGLE THROW
	SWITCH AND FUSE; RATING AS SHOWN ON PLANS	ELEC, E	ELECTRICAL	SWBD	SWITCHBOARD
/ /⊦	NORMALLY OPEN CONTACT NORMALLY CLOSED CONTACT	ELEV	ELEVATOR	SWGR	SWITCH GEAR
×r	GROUND ROD IN GROUND WELL	EM	EMERGENCY	V	VOLT
		EMT	ELECTRO METALLIC TUBING	VD	VOLTAGE DROP
<u>-</u>	WALL JUNCTION BOX (FLOOR PLAN SYMBOL)	FLA	FULL LOAD AMPS (NAME PLATE)	VA	VOLT AMPERES
<u> </u>	CELING MOUNTED JUNCTION BOX (FLOOR PLAN SYMBOL) PUSH BUTTON STATION (FLOOR PLAN SYMBOL)	FLC	FULL LOAD CURRENT (NEC)	W	WATT
	· · · · · · · · · · · · · · · · · · ·	(F)	FUTURE	W	WIRE
	TRANSFORMER (FLOOR PLAN SYMBOL)	GFCI	GROUND FAULT CIRCUIT INTERRUPTING	XFMR	TRANSFORMER
Р	PUSH PLATE (FOR AUTOMATIC DOOR)				
PB	PUSH BUTTON (FOR AUTOMATIC DOOR)				
	277/480 SURFACE MOUNTED PANELBOARD (FLOOR PLAN SYMBOL)		ELECTRICAL	UKAVV	INUEX
	277/480 FLUSH MOUNTED PANELBOARD (FLOOR PLAN SYMBOL)	E0.00	ELECTRICAL COVER SHEET		
	120/208 SURFACE MOUNTED PANELBOARD (FLOOR PLAN SYMBOL)	E1.00 E1.01	ELECTRICAL OVERALL SITE PLAN ELECTRICAL ENLARGED SITE PLA		L SINGLE LINE

SINGLE LINE DIAGRAM LEGEND				
	(E) - EXISTING TO REMAIN			
	(D) - DEMOLITION WORK			
	(N) - NEW WORK			
	(F) FUTURE WORK			
100NG	FEEDER TAG			

120/208 FLUSH MOUNTED PANELBOARD (FLOOR PLAN SYMBOL)

-(A) WALL MOUNTED AUTO SINK TOILET OUTLET (FLOOR PLAN SYMBOL)

AUTO SINK TOILET OUTLET (FLOOR PLAN SYMBOL)

File: X:\P\618184\(4) ENGINEERING\(2) PLAN SETS\(3) SHEET SET\DW BOOSTER\SAMPLE.dwg Date: ----




E3 (E)SWITCHBOARD_

(E)200KVA

TRANSFORMER

(E)ELECTRICAL VAULT (E6) WITH (4) SPARE

PENETRATIONS

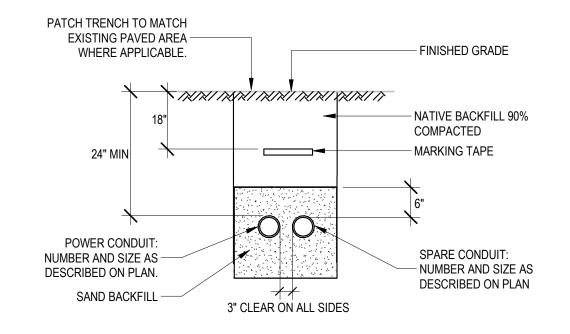

NOTE:

1. REFER TO NEC ARTICLE 300.5 FOR MINIMUM COVER REQUIREMENTS. 2. REFER TO SPECIFICATIONS FOR SEPARATION REQUIREMENTS BETWEEN POWER AND OTHER UTILITIES.

SAND BACKFILL DUCTBANK IN EXISTING

SWITCHGEAR-

SHEET NOTES

- A. INFORMATION SHOWN IS BASED ON EXISTING DESIGN DRAWINGS AND LIMITED FIELD J. IF EXISTING MANHOLES/HANDHOLES ARE FILLED WITH WATER, CONTRACTOR SHALL INVESTIGATION. VERIFY EXACT SIZES, LOCATIONS, AND OTHER CONDITIONS IN THE FIELD. IF DISCOVERED CONDITIONS DIFFER SIGNIFICANTLY FROM CONDITIONS SHOWN, SUCH THAT THE EXTENT OF DEMOLITION OR NEW CONNECTIONS ARE UNCLEAR, COORDINATE WITH THE OWNER'S REPRESENTATIVE PRIOR TO PROCEEDING WITH THE WORK.
- B. EQUIPMENT LOCATIONS AND CONDUIT ROUTING ARE SHOWN DIAGRAMMATICALLY. DO NOT DIMENSION OFF THOSE DRAWINGS. THESE DRAWINGS REPRESENT THE BASIC INTENT OF THE SCOPE. VERIFY ACTUAL CONDITIONS WITH SITE UTILITY DRAWINGS AND CONDUCT ADDITIONAL SITE INVESTIGATIONS AS REQUIRED.
- C. PRIOR TO PROCEEDING WITH ANY EXCAVATION OR TRENCHING, LOCATE USING INDEPENDENT ELECTRONIC LOCATOR SERVICE AND IDENTIFY EXISTING UNDERGROUND SERVICES AND UTILITIES WITHIN CONTRACT WORK LIMIT AREAS. PROVIDE ADEQUATE MEANS OF PROTECTION OF EXISTING UTILITIES AND SERVICES. REPAIR UTILITIES DAMAGED DURING EARTHWORK OPERATION AT CONTRACTOR'S EXPENSE.
- D. PROTECTION OF EXISTING TREES AND SHRUBS: a. EXISTING TREES AND SHRUBS SHALL BE PROTECTED FROM DAMAGE DURING
- CONSTRUCTION. b. TREES AND SHRUBS DAMAGED DURING CONSTRUCTION SHALL BE REPLACED IN
- KIND AS PART OF THE BASE BID. c. LOCATE AND CAP EXISTING IRRIGATION TO PREVENT POSSIBLE WATER RUNOFF ONTO CONSTRUCTION AREA WHILE MINIMIZING DAMAGE TO ADJACENT
- UNDISTRUBED PLANTED AND IRRIGATED AREAS. d. AFTER TRENCHING, BACKFILL, AND COMPACTION, THE CONTRACTOR SHALL PROVIDE GROUND COVER TO MATCH THE SURROUNDING AREAS.
- E. CONTRACTOR SHALL TAKE ALL PRECAUTIONS TO PREVENT EROSION DURING CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONTINUOUS MAINTENANCE OF EROSION CONTROL DEVICES DURING CONSTRUCTION.
- F. LOOSE SOIL AND EBRIS SHALL BE REMOVED FROM ROAD AREAS UPON STARTING OPERATIONS AND PERIODICALLY THEREAFTER AS DIRECTED BY THE OWNER'S REPRESENTATIVE.
- G. PAVED ROADWAYS, SIDEWALKS, AND OTHER IMPROVEMENTS SHALL BE MAINTAINED IN A NEAT AND CLEAN CONDITION, FREE OF LOOSE SOIL, CONSTRUCTION DEBRIS, AND TRASH. ROADWAY SWEEPING OR OTHER EQUALLY EFFECTIVE MEANS SHALL BE USED ON A REGULAR BASIS TO REMOVE DEPOSITED MATERIALS. WATER SHALL NOT BE USED TO CLEAN ROADWAY EXCEPT OF FINE MATERIAL NOT OTHERWISE REMOVED BY SWEEPING OR OTHER MECHANICAL MEANS.
- H. CONTRACTOR SHALL MAINTAIN CONNECTIVITY TO ALL EXISTING SERVICES. IF EXISTING SERVICES NEED TO BE INTERRUPTED FOR ANY REASON, COORDINATE SERVICE OUTAGE WITH OWNER'S REPRESENTATIVE PRIOR TO SERVICE INTERRUPTION.
- I. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PRESERVATION OF EXISTING UNDERGROUND IRRIGATION CONDUIT AND WIRE, IRRIGATION PIPING (INCLUDING SPRINKLER HEADS) OR OTHER PIPING TO PREVENT POSSIBLE WATER RUNOFF ONTO CONSTRUCTION AREA WHILE MINIMIZING DAMAGE TO ADJACENT UNDISTURBED PLANTED AND IRRIGATION AREAS.

- BE RESPONSIBLE TO PUMP OUT WATER PRIOR TO STARTING WORK INSIDE MANHOLES/HANDHOLES.
- K. CAREFUL PLANNING OF WORK IS REQUIRED AND MUST BE CAREFULLY COORDINATED WITH FACILITY TO MINIMIZE SHUT-DOWNS OF SYSTEMS. CONTRACTOR TO SUBMIT DETAILED WORK SEQUENCE PLAN TO CAMPUS FACILITIES AND RECEIVE WRITTEN APPROVAL PRIOR TO COMMENCING ANY WORK WHICH MAY INTERUPT UTILITY SERVICES FOR CAMPUS OPERATIONS.
- L. CONTRACTOR SHALL REFER TO CIVIL DRAWINGS FOR EXACT DUCTBANK ROUTING, MANHOLE LOCATIONS, TRENCH LOCATIONS AND ELEVATIONS.
- M. OPEN TRENCHES SHALL NOT REMAIN UNCOVERED OVERNIGHT. STEEL PLATES SHALL BE PROVIDED TO COVER OPEN TRENCHES OVERNIGHT AND DURING PERIODS WHEN ACCESS TO TRENCHES IS NOT REQUIRED.
- N. UTILITY TRENCHES SHALL BE BACKFILLED WITHIN 24 HOURS AND MUST BE BACKFILLED PRIOR TO THE END OF THE WORK DAY IF A 20 PERCENT CHANCE OF RAIN IS PREDICTED.

- DOMESTIC WATER BOOSTER PUMP PACKAGED SYSTEM: 480V, 3PH, (2)15HP + (1)15HP REDUNDANT, 53.9FLA. SYSTEM CONTROL PANEL WITH VFDS FURNISHED BY MANUFACTURER AND INSTALLED BY DIVISION 22, CONNECTED BY DIVISION 26. ELECTRICAL CONTRACTOR TO MAKE SINGLE POINT POWER CONNECTION AT CONTROL PANEL PER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE CONDUIT AND WIRING FROM EXISTING SWITCHBOARD 'SWBD' TO NEW DOMESTIC WATER BOOSTER PUMP.
- MODIFIED LOADS ON EXISTING PANELBOARD.
- USE EXISTING 70A, 3P BREAKER (BALL FIELD CURRENTLY SPARE) FOR NEW CONNECTION TO DOMESTIC WATER BOOSTER PUMP.
- PROVIDE PRECAST CONCRETE HANDHOLE WITH CONCRETE COVER AND NO BOTTOM SLAB. MINIMUM SIZE: 10.5"W X 13.5"L (PER NEC 314.28 AND NEC 314.30). USE EXISTING PENETRATIONS WITHIN EXISTING VAULT TO ROUTE CONDUIT.

SPARE CONDUIT TO TERMINATE WITHIN PULLBOXES PB-1 AND PB-2.



CIVIL ENGINEERS

220 MONTGOMERY STREET,

SAN FRANCISCO, CA

Project Number: 200-098

SILICON VALLEY TRI-VALLEY

CENTRAL VALLEY EAST BAY/SF

P. 510.873.8866

F. 510.873.8868

www.sandis.net

SURVEYORS


PLANNERS


SUITE 650

94104 | USA

(T) 415 362 3266

www.mazzetti.com

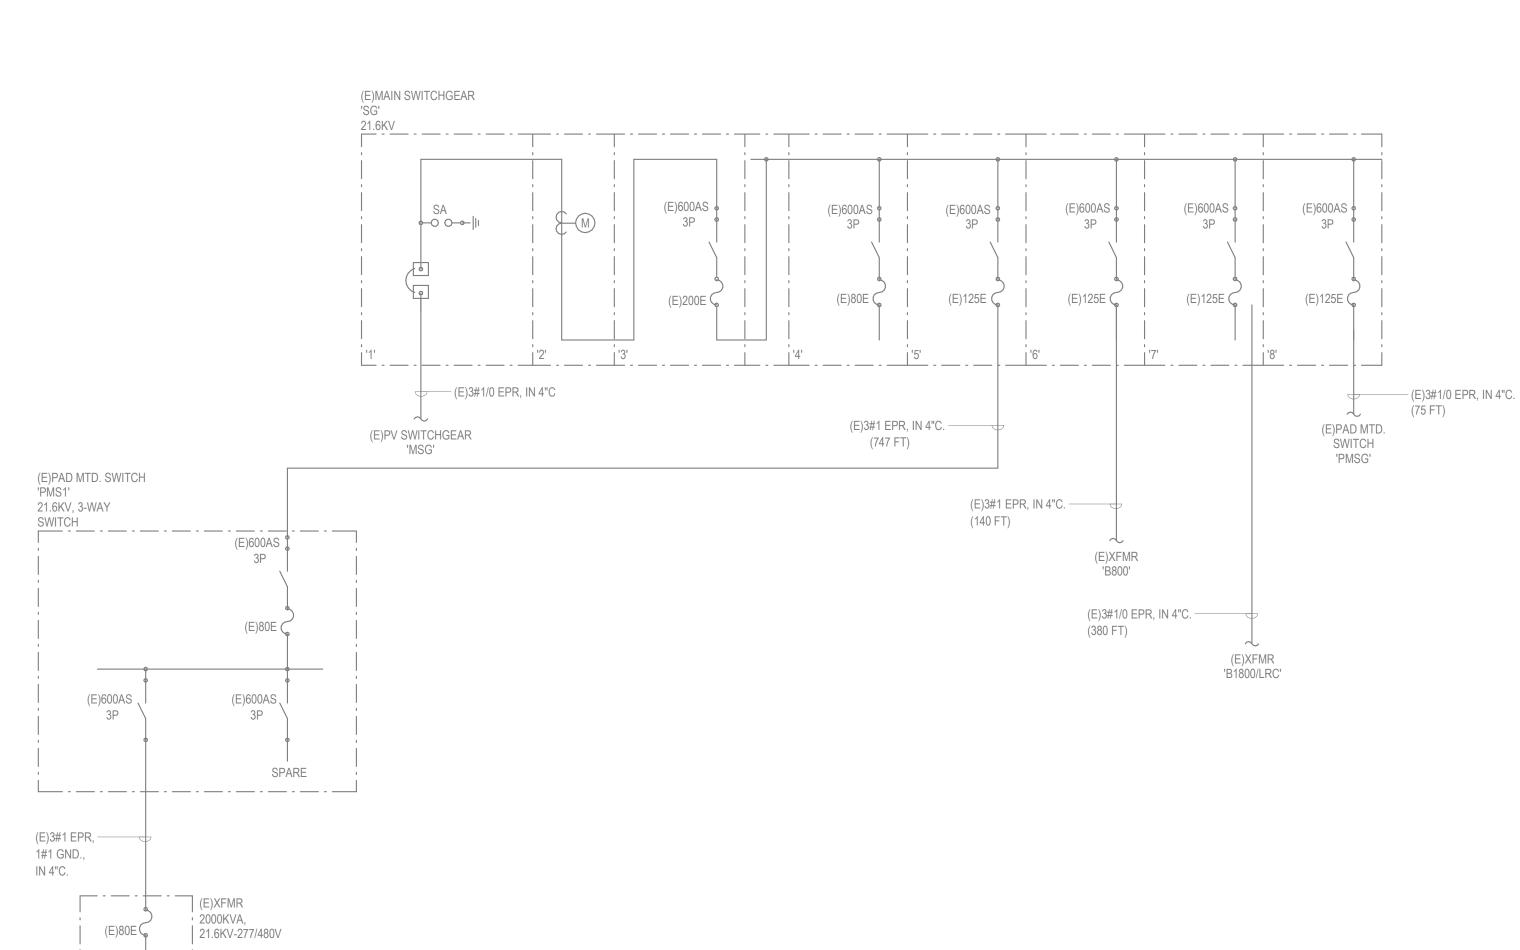

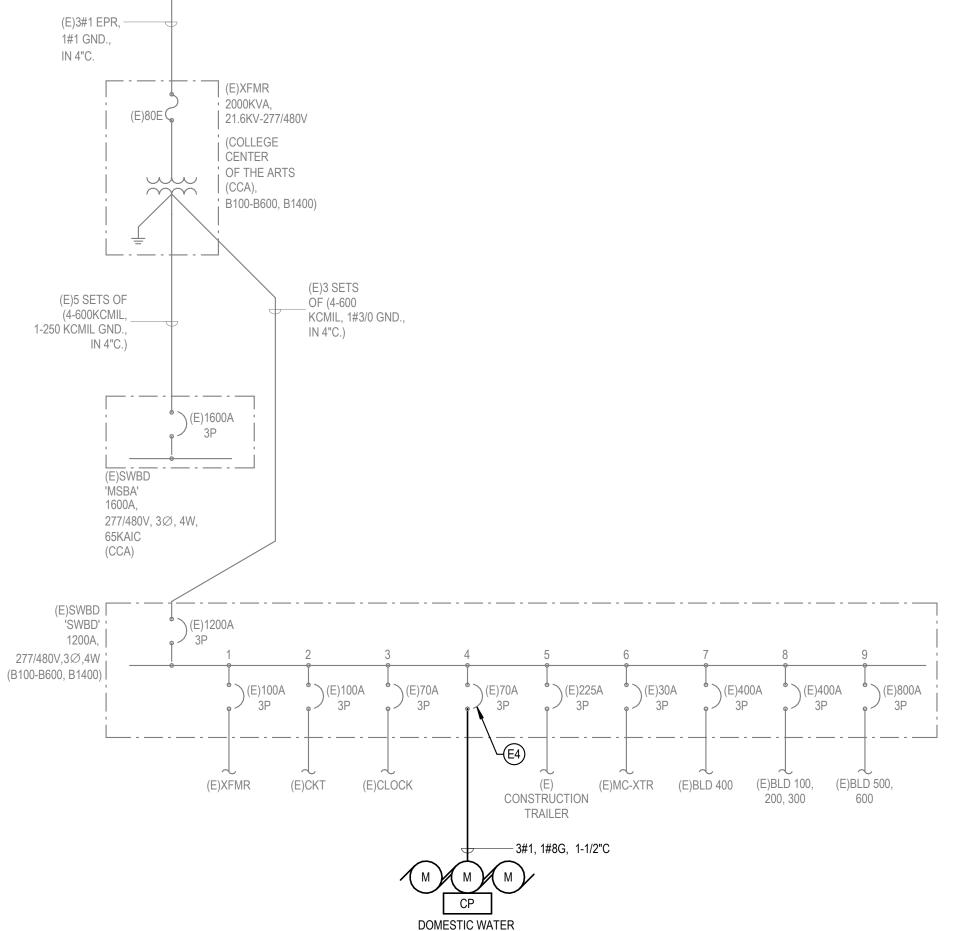

BOOSTER PUMP

ELECTRICAL PARTIAL SINGLE LINE DIAGRAM

NOT TO SCALE

ELECTRICAL ENLARGED SITE PLAN & PARTIAL SINGLE LINE

E1.01

SHEET

File: X:\P\618184\(4) ENGINEERING\(2) PLAN SETS\(3) SHEET SET\DW BOOSTER\SAMPLE.dwg Date: ----

ELECTRICAL ENLARGED SITE PLAN

PROPOSED EXTERIOR RATED DOMESTIC WATER BOOSTER PUMP (TRIPLEX) SKID LOCATION

SINGLE (1) PHASE VOLTAGE DROP CALCULATION:

 $VD = (2 \times L \times R \times I)/1000$

 $VD\% = (VD/V) \times 100$

No. REVISION APPROVED BY: DRAWING NO.: